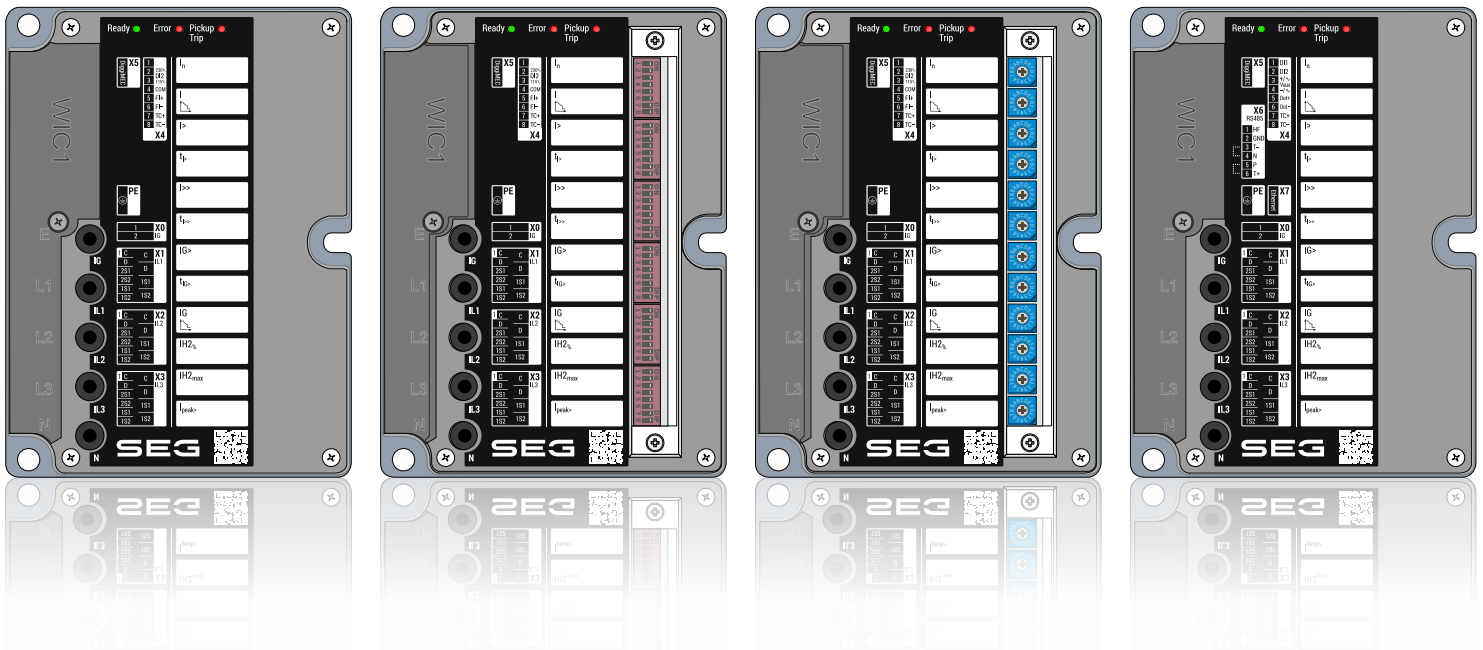


WI Line

WIC1

SELF-/DUAL-POWERED PROTECTION DEVICE

- WIC1-1 | Self-powered device, parameter settings via DiggiMEC / Smart view
- WIC1-2 | Self-powered device, parameter settings via DIP switches and/or DiggiMEC / Smart view
- WIC1-3 | Self-powered device, parameter settings via HEX switches and/or DiggiMEC / Smart view
- WIC1-4 | Dual-powered device, parameter settings via DiggiMEC / Smart view



SELF-/DUAL-POWERED PROTECTION DEVICE

Version: 2.0.b

Original document

English

REFERENCE MANUAL WIC1-2.0-EN-REF

Build 58110

Revision A

Reference manual

SEG Electronics GmbH

Krefelder Weg 47 • D-47906 Kempen (Germany)

Telephone: +49 (0) 21 52 145 1

Internet: www.SEGelectronics.de

Sales

Telephone: +49 (0) 21 52 145 331

Fax: +49 (0) 21 52 145 354

E-mail: sales@SEGelectronics.de

Service

Telephone: +49 (0) 21 52 145 600

Fax: +49 (0) 21 52 145 354

E-mail: support@SEGelectronics.de

SEG Electronics GmbH reserves the right to update any portion of this publication at any time.

Information provided by SEG Electronics GmbH is believed to be correct and reliable.

However, no responsibility is assumed by SEG Electronics GmbH unless otherwise expressly undertaken.

© 2022 SEG Electronics GmbH. All rights reserved.

Table of Contents

1	About This Reference Manual	8
2	Hardware	11
2.1	Device Configuration	11
2.2	DiggiMEC	13
2.2.1	DiggiMEC: Device Planning Parameters	13
2.2.2	DiggiMEC: Settings	13
3	Security	16
4	Field settings	17
4.1	CT – Current Transformer	17
4.1.1	CT: Settings	17
4.1.2	CT: Direct Controls	20
4.1.3	CT: Values	23
5	System	26
5.1	Time	26
5.2	Sys – System	27
5.2.1	Sys: Direct Controls	27
5.2.2	Sys: Values	27
6	Measured Values	29
7	Statistics	30
7.1	Peak Current Ptr – Statistic of the current measuring values	31
7.1.1	Peak Current Ptr: Settings	31
7.1.2	Peak Current Ptr: Direct Controls	31
7.1.3	Peak Current Ptr: Values	31
7.2	Life Load – Load Current Histogram	32
7.2.1	Life Load: Device Planning Parameters	32
7.2.2	Life Load: Settings	32
7.2.3	Life Load: Direct Controls	32
7.2.4	Life Load: Input States	33

7.2.5	Life Load: Signals (Output States)	33
7.2.6	Life Load: Values	33
8	Communication	34
8.1	Modbus	34
8.1.1	Modbus: Device Planning Parameters	34
8.1.2	Modbus: Settings	34
8.1.3	Modbus: Direct Controls	35
8.1.4	Modbus: Values	35
9	Protection Parameter	36
9.1	Prot: Device Planning Parameters	36
9.2	Prot: Settings	36
9.3	Prot: Direct Controls	43
9.4	Prot: Input States	44
9.5	Prot: Signals (Output States)	44
9.6	Prot: Values	47
9.7	IH2 – Module Inrush	48
9.7.1	IH2: Device Planning Parameters	48
9.7.2	IH2: Settings	48
9.7.3	IH2: Signals (Output States)	49
9.8	I> – Phase Overcurrent Stage	50
9.8.1	I>: Device Planning Parameters	50
9.8.2	I>: Settings	50
9.8.3	I>: Input States	54
9.8.4	I>: Signals (Output States)	54
9.9	I>> – Phase Overcurrent Stage	57
9.9.1	I>>: Device Planning Parameters	57
9.9.2	I>>: Settings	57
9.9.3	I>>: Input States	61
9.9.4	I>>: Signals (Output States)	61
9.10	I>>> – Phase Overcurrent Stage	64
9.10.1	I>>>: Device Planning Parameters	64
9.10.2	I>>>: Settings	64

9.10.3	I>>>: Input States	68
9.10.4	I>>>: Signals (Output States)	68
9.11	IG> - Ground (earth) current protection stage	71
9.11.1	IG>: Device Planning Parameters	71
9.11.2	IG>: Settings	71
9.11.3	IG>: Input States	76
9.11.4	IG>: Signals (Output States)	76
9.12	IG>> - Ground (earth) current protection stage	78
9.12.1	IG>>: Device Planning Parameters	78
9.12.2	IG>>: Settings	78
9.12.3	IG>>: Input States	83
9.12.4	IG>>: Signals (Output States)	83
9.13	I2/I1> - Unbalanced Load Protection	85
9.13.1	I2/I1>: Device Planning Parameters	85
9.13.2	I2/I1>: Settings	85
9.13.3	I2/I1>: Input States	86
9.13.4	I2/I1>: Signals (Output States)	86
9.14	I2> - Negative-Sequence Current Protection	88
9.14.1	I2>: Device Planning Parameters	88
9.14.2	I2>: Settings	88
9.14.3	I2>: Input States	91
9.14.4	I2>: Signals (Output States)	91
9.15	ThR - Thermal replica module	93
9.15.1	ThR: Device Planning Parameters	93
9.15.2	ThR: Settings	93
9.15.3	ThR: Direct Controls	94
9.15.4	ThR: Input States	94
9.15.5	ThR: Signals (Output States)	94
9.15.6	ThR: Values	95
9.16	Ipeak> - Peak-Value Overcurrent	96
9.16.1	Ipeak>: Device Planning Parameters	96
9.16.2	Ipeak>: Settings	96

9.16.3	lpeak>: Input States	97
9.16.4	lpeak>: Signals (Output States)	97
9.17	SOTF – Switch Onto Fault - Module	99
9.17.1	SOTF: Device Planning Parameters	99
9.17.2	SOTF: Settings	99
9.17.3	SOTF: Input States	100
9.17.4	SOTF: Signals (Output States)	100
9.18	ExP[1] – External Protection - Module	102
9.18.1	ExP[1]: Device Planning Parameters	102
9.18.2	ExP[1]: Settings	102
9.18.3	ExP[1]: Input States	104
9.18.4	ExP[1]: Signals (Output States)	104
9.19	ExP[2] – External Protection - Module	105
9.19.1	ExP[2]: Device Planning Parameters	105
9.19.2	ExP[2]: Settings	105
9.19.3	ExP[2]: Input States	107
9.19.4	ExP[2]: Signals (Output States)	107
9.20	CBF – Circuit breaker failure protection module	109
9.20.1	CBF: Device Planning Parameters	109
9.20.2	CBF: Settings	109
9.20.3	CBF: Input States	109
9.20.4	CBF: Signals (Output States)	109
9.21	CLPU – Cold Load Pickup Module	111
9.21.1	CLPU: Device Planning Parameters	111
9.21.2	CLPU: Settings	111
9.21.3	CLPU: Input States	112
9.21.4	CLPU: Signals (Output States)	112
9.22	Supervision	113
9.22.1	TCM – Trip Circuit Monitoring	113
9.22.2	BkrWear – Breaker Wear	115
9.22.3	SBM – Station Battery Monitoring	118
10	Records	119

10.1	Fault recorder	119
11	Self-Supervision	120
11.1	Self-Supervision	120
12	Service	121
13	Selection Lists	122
14	Index	147

1 About This Reference Manual

This document is a reference of all the Setting Values, Direct Commands and Signals of the WIC1. In other words, it lists all parameters that are available (or can be made available) with the (optionally) full featured versions of the WIC1 protection device.

CAUTION!



This document does not intend to give long and/or detailed description, nor does it intend to replace the full Technical Manual in any way. Only a quite short description is given for each parameter.

This document is a reference of all the Setting Values, Direct Commands and Signals of the WIC1.

Every WI Line protection device operates using a lot of digital values of various types. Throughout our Technical Documentation, we are talking of “settings” (or “parameters”) or “signals” or “(measured) values”, depending on the type.

Please consult the Technical Manual, in particular Chapter “Modules, Settings, Signals and Values”, for details of the existing data types.

Modules

The firmware of every WI Line protection device can be thought of being sub-divided in several independent function blocks, the so-called “modules”. Every protection function, for example, is a module of its own. But one of the fundamental concepts of a WI Line protection device is to implement this with great consequence.

For example, the functionality of calculating statistical data is a module (named »Statistics«), every communication protocol is a module, the control of switchgear devices is a module (named »Ctrl«), but the properties of the switchgear itself is part of another module.

There is even a general protection module (named »Prot«) that interacts all specific protection modules.

Every parameter, every value and every signal is therefore a member of some module.

But note that the settings dialogs (on the panel (HMI) or in the *Smart view* operating software) often omit the module name whenever it is clear from the menu branch. This means the parameters are often displayed only with their individual parameter names, i. e. simply »Function« instead of the full-blown »I2>[1] . Function«. This increases the overview and simplifies all configuration and operation work; however, it is good to know that the writing »Function« is just an abbreviation. In fact, **every** parameter **always** belongs to a module, and therefore - to make this concept absolutely clear - the reference tables have always the module name added in front of every parameter name

Especially for protection functions it is often required to have several instances active. For example, overcurrent protection usually has several “stages”, and all of these are running at the same time (using their individual setting values). Therefore it is an important feature of every WI Line protection device that a lot of modules exist in several “instances”, which are numbered (in brackets), for example: »I2>[1]«, I2>[2]«

In the reference tables, usually every module has its own dedicated chapter, which lists the available number of instances at the beginning. Then, however, in the sub-chapters listing the various parameter types, only the first instance (e. g. »I2>[1]«) is mentioned, because all the other instances are identical anyway.









Structure of a Reference Table

Since (almost) every module can be activated or deactivated independently of the other modules and all parameters of an inactive module disappear from the menu branch it would not be helpful if this Reference Manual would list parameters sorted according to the menu structure. Instead, we list categories of modules (e. g. “Protection Functions”) and all the modules within a category.

For each parameter, there is a table with its properties, looking like this:



Module . Parameter	[Menu Path to This Parameter]	
Default Value	Value Range	
For some parameters:		
<ul style="list-style-type: none"> • Availability restrictions 		
Type <i>Short descriptive text explaining the functionality of this parameter.</i>		


“Type” is the data type of the parameter, which is denoted by a small icon. The following types are possible:

-  Setting Parameter
-  Direct Control
-  Input State
-  Signal (Output State)
-  Statistical Value
-  Counter
-  (Measuring) Value
-  Dialog — Such a dialog can feature several data objects using a special representation and/or functionality.

For some parameter types (e. g. Input and Output States), the second row (default, value range, permission) is useless and therefore omitted.

Example of a parameter:

ExP[1] . Mode	[Device planning]	
use	-, use	
	 Mode	
 <i>general operation mode</i>		

This means that one can find the parameter in the menu [Device planning], and its values are picked from a selection list named “Mode”. The “” arrow indicates a cross-reference (hyperlink) into the “Selection Lists” chapter, and a click takes you to a table that lists all available choices.

Audience of This Manual

The manual serves as working basis for:

- Engineers in the protection field,
- commissioning engineers,
- people dealing with setting, testing and maintenance of protection and control devices,
- as well as trained personnel for electrical installations and power stations.

All functions concerning the WIC1 are listed. Should there be a description of any functions, parameters or inputs/outputs which do not apply to the device in use, please ignore that information.

This manual describes the (optionally) full featured versions of the devices.

All technical information and data included in this manual reflect their state at the time this document was issued. We reserve the right to carry out technical modifications in line with further development without changing this manual and without previous notice. Hence no claim can be brought based on the information and descriptions this manual includes.

We do not accept any liability for damage and operational failures caused by operating errors or disregarding the directions of this manual.

No part of this manual is allowed to be reproduced or passed on to others in any form, unless *SEG* have approved in writing.

This Reference Manual is part of the delivery scope when purchasing the device. In case the device is passed on (sold) to a third party, the manual has to be handed over as well.

Information Concerning Liability and Warranty

SEG does not accept any liability for damage resulting from conversions or changes carried out on the device or planning (projecting) work, parameter setting or adjustment changes done by the customer.

The warranty expires after a device has been opened by others than *SEG* specialists.

Warranty and liability conditions stated in *SEG* General Terms and Conditions are not supplemented by the above-mentioned explanations.

2 Hardware


2.1 Device Configuration

Self-/Dual-Powered Protection Device										
WIC1	-2	#	#	#	#	#	#	#	#	#
Device Variant										
Self-powered device, parameter settings via DiggiMEC / Smart view	1									
Self-powered device, parameter settings via DIP switches and/or DiggiMEC / Smart view	2									
Self-powered device, parameter settings via HEX switches and/or DiggiMEC / Smart view	3									
Dual-powered device, parameter settings via DiggiMEC / Smart view	4									
CT Type										
The WIC1-compatible CTs (WIC1WE1AS1 ... WIC1W6AS1) are used for the phase current measuring inputs.	S									
Special Broad-Range CTs (2 secondary windings) shall be connected to the phase current measuring inputs.	B									
Ground Current Method										
The ground (earth) current is calculated out of the measured phase currents.	N									
The ground (earth) current can be measured at a dedicated 4th CT input. However, the device can also be set (via DiggiMEC / Smart view) to operate using calculated ground (earth) current.	G									
Nominal Frequency										
The nominal frequency can be set to 50 Hz or 60 Hz (via DiggiMEC / Smart view).	0									
The factory preset for the nominal frequency is 50 Hz, but can also be set to 60 Hz (via DiggiMEC / Smart view).	5									
The factory preset for the nominal frequency is 60 Hz, but can also be set to 50 Hz (via DiggiMEC / Smart view).	6									
Outputs										
The Trip Command is assigned to the "TC" (Trip Coil pulse) output. (This assignment is pre-defined and fixed.)	N									


Self-/Dual-Powered Protection Device										
WIC1	-2	#	#	#	#	#	#	#	#	#
The Trip Command is assigned to both the “TC” (Trip Coil pulse) output and to the “FI” (Flag Indicator) output. (These assignments are pre-defined and fixed.)							F			
The Trip Command is fixed and assigned to the “TC” (Trip Coil pulse) output. The “FI” (Flag Indicator) output is configurable, i.e. can be set to any output signal.							C			
Inputs										
Without Digital Inputs							N			
Digital Input (115 VAC or 230 VAC) for external trip.							F			
Digital Input (115 VAC or 230 VAC), configurable.							C			
Without Digital Inputs							M			
Digital Inputs for external trip and external reset.							G			
The Digital Inputs are configurable.							D			
Backup Protection										
The integrated backup protection starts to operate as soon as there is enough electrical energy for a trip impulse.								1		
The integrated backup protection starts to operate at 20 In,max.								2		
Protection Packages										
ANSI 50, 51, 50G/N, 51G/N, inrush, 50BF, 74TC									S	
Package “S” + 46, 49, 51Q, Breaker Wear, Condition Monit.									A	
Package “A” + SOTF, CLPU, ExP, ultra-f.OC									P	
Communication										
Without										A
RS 485: Modbus RTU										B
Ethernet: Modbus TCP										C
Ethernet/Fiber Optics: Modbus TCP										L


2.2 DiggiMEC


2.2.1 DiggiMEC: Device Planning Parameters


DiggiMEC . Mode	[Device planning / WIC1 + DiggiMEC]	
	“-”, DiggiMEC-A, DiggiMEC-B ↳ Device planning	P.1
 DiggiMEC, general operation mode		

2.2.2 DiggiMEC: Settings

DiggiMEC . Menu language	[Device Para / DiggiMEC / General Settings]	
English	English ↳ My Language	P.1
 Selection of the language		



DiggiMEC . Operation Preference	[Device Para / DiggiMEC / General Settings]	
Precise meas.	Precise meas., Early wake-up ↳ Operation Preference	P.1
 <i>If set to “Early wake-up”, the DiggiMEC is fully available at smaller primary currents, but at the cost of more inaccurate WIC1 measurement values. If set to “Precise meas.”, the DiggiMEC gets fully available only with higher primary currents, but the WIC1 measurement values will be more precise. In general, it is recommended to keep the default “Precise meas.”.</i>		



DiggiMEC . FI / BO 1 assign.	[Device Para / DiggiMEC / FI / BO]	
Prot . TripCmd Only available if: • DiggiMEC . Mode = DiggiMEC-B	“-” ... Prot . Pos OFF ↳	P.1
 Assignment of the Flag Indicator / bistable output relay		



DiggiMEC . FI / BO 1 latching	[Device Para / DiggiMEC / FI / BO]	
Latch. w. Auto-Reset Only available if: • DiggiMEC . Mode = DiggiMEC-B	No latching, With latching, Latch. w. Auto-Reset ↳ Latching	P.1
 <i>Defines whether the Flag Indicator/output relay will be latched when it is set. In case it is set as latched then you also have a choice between several automatical reset modes.</i>		



2 Hardware



2.2.2 DiggiMEC: Settings



DiggiMEC . FI / BO 2 assign.		[Device Para / DiggiMEC / FI / BO]
Prot . Trip IPh	“-” ... Prot . Pos OFF	P.1
		
 <i>Assignment of the Flag Indicator / bistable output relay</i>		



DiggiMEC . FI / BO 2 latching		[Device Para / DiggiMEC / FI / BO]
Latch. w. Auto-Reset	No latching, With latching, Latch. w. Auto-Reset	P.1
		 Latching
 <i>Defines whether the Flag Indicator/output relay will be latched when it is set. In case it is set as latched then you also have a choice between several automatical reset modes.</i>		

DiggiMEC . FI / BO 3 assign.		[Device Para / DiggiMEC / FI / BO]
Prot . Trip IG	“-” ... Prot . Pos OFF	P.1
Only available if:		
<ul style="list-style-type: none"> DiggiMEC . Mode = DiggiMEC-B 		
 <i>Assignment of the Flag Indicator / bistable output relay</i>		



DiggiMEC . FI / BO 3 latching		[Device Para / DiggiMEC / FI / BO]
Latch. w. Auto-Reset	No latching, With latching, Latch. w. Auto-Reset	P.1
Only available if:		 Latching
<ul style="list-style-type: none"> DiggiMEC . Mode = DiggiMEC-B 		
 <i>Defines whether the Flag Indicator/output relay will be latched when it is set. In case it is set as latched then you also have a choice between several automatical reset modes.</i>		



DiggiMEC . LED2 assign.		[Device Para / DiggiMEC / LEDs]
TCM . Alarm	“-” ... Prot . Pos OFF	P.1
		
 <i>Assignment of the LED 2</i>		

DiggiMEC . LED2 Color		[Device Para / DiggiMEC / LEDs]
DiggiMEC . LED3 Color		
Red	Red, Green, Green / Red	P.1
		 Color
 <i>Select the “active” color (if the assigned signal is active) and the “inactive” color (if the assigned signal is inactive)</i>		

DiggiMEC . LED2 latching		[Device Para / DiggiMEC / LEDs]
With latching	No latching, With latching, Latch. w. Auto-Reset	P.1
	 Latching	
	<i>Defines whether the LED will be latched when it is set. In case it is set as latched then you also have a choice between several automatic reset modes.</i>	

DiggiMEC . LED3 assign.		[Device Para / DiggiMEC / LEDs]
Prot . Trip	"-" ... Prot . Pos OFF	P.1
		
	<i>Assignment of the LED 3</i>	

DiggiMEC . LED3 latching		[Device Para / DiggiMEC / LEDs]
Latch. w. Auto-Reset	No latching, With latching, Latch. w. Auto-Reset	P.1
	 Latching	
	<i>Defines whether the LED will be latched when it is set. In case it is set as latched then you also have a choice between several automatic reset modes.</i>	

DiggiMEC . Reset via »C« key		[Device Para / Reset]
Without Password	Without Password, With Password	P.1
	 Reset via »C« key	
	<i>Select whether a reset via »C« key shall be password-protected.</i>	

3 Security

Password

[Device Para / Security / Password]








This item represents a special dialog. (See the Technical Manual for details.)

Changing the password


4 Field settings


4.1 CT - Current Transformer

4.1.1 CT: Settings

CT . Phase Sequence		[Field Para / General Settings]	
ABC	ABC, ACB	↳ Phase Sequence	P.1
	<i>Phase Sequence</i>		
CT . f		[Field Para / General Settings]	
	50 Hz, 60 Hz	↳ fN	P.1
	<i>Nominal frequency</i>		
CT . Measuring method		[Field Para / General Settings]	
Fundamental	Fundamental, True RMS	↳ Measuring method	P.1
	<i>Measuring method for the protection stages I>, I>>, I>>>, IG>, IG>>: Fundamental or RMS</i>		
CT . IG Source		[Field Para / General Settings]	
	If: Device Variant with Ground Current Inputs = True <ul style="list-style-type: none"> • calculated, measured If: Device Variant with Ground Current Inputs = False <ul style="list-style-type: none"> • calculated ↳ IG Source		P.1
	<i>Selection if measured or calculated ground current should be used.</i>		
CT . Display of Meas. Values		[Field Para / CT]	
Based on In,relative	If: CT . CT Type = Relative <ul style="list-style-type: none"> • Based on In,relative If: CT . CT Type ≠ Relative <ul style="list-style-type: none"> • Based on In,relative, Primary current values ↳ Display of Meas. Values		P.1
<i>Only available if:</i> <ul style="list-style-type: none"> • Prot . Settings valid = Software 			
	<i>Select the preferred scaling/unit for the display of measurement values.</i>		

4 Field settings
4.1.1 CT: Settings

CT . CT Type	[Field Para / CT]	
Relative <i>Only available if:</i> • Prot . Settings valid = Software	Relative ... Standard ↳ CT Type	P.1
 <i>Select the connected CT Type (for the display of primary or relative phase current values).</i>		


CT . In,relative	[Field Para / CT]	
1.000In.min <i>Only available if:</i> • CT . CT Type = Relative	1.000In.min ... 3.500In.min	P.1
 <i>Relative primary rated current. (This is the rated current divided by the CT ratio, i.e. a value that has been made independent of the CT type.)</i>		


CT . CT pri	[Field Para / CT]	
0A <i>Only available if:</i> • Prot . Settings valid = Software	If: CT . CT Type = Relative <ul style="list-style-type: none"> • 0A ... 0A • 0A ... 56.0A • 0A ... 56.0A • 0A ... 112.0A • 0A ... 224.0A • 0A ... 448.0A • 0A ... 896.0A • 0A ... 10000.0A • 16.0A ... 0A If: CT . CT Type = WE2 : 16 A ... 56 A <ul style="list-style-type: none"> • 16.0A ... 56.0A • 16.0A ... 56.0A • 16.0A ... 112.0A • 16.0A ... 224.0A • 16.0A ... 448.0A • 16.0A ... 896.0A • 16.0A ... 10000.0A • 16.0A ... 0A • 16.0A ... 56.0A If: CT . CT Type = W2 : 16 A ... 56 A <ul style="list-style-type: none"> • 16.0A ... 56.0A • 16.0A ... 112.0A • 16.0A ... 224.0A • 16.0A ... 448.0A 	P.1



CT . CT pri	[Field Para / CT]
	<ul style="list-style-type: none"> • 16.0A ... 896.0A • 16.0A ... 10000.0A • 32.0A ... 0A • 32.0A ... 56.0A • 32.0A ... 56.0A <p>If: CT . CT Type = W3 : 32 A ... 112 A</p> <ul style="list-style-type: none"> • 32.0A ... 112.0A • 32.0A ... 224.0A • 32.0A ... 448.0A • 32.0A ... 896.0A • 32.0A ... 10000.0A • 64.0A ... 0A • 64.0A ... 56.0A • 64.0A ... 56.0A • 64.0A ... 112.0A <p>If: CT . CT Type = W4 : 64 A ... 224 A</p> <ul style="list-style-type: none"> • 64.0A ... 224.0A • 64.0A ... 448.0A • 64.0A ... 896.0A • 64.0A ... 10000.0A • 128.0A ... 0A • 128.0A ... 56.0A • 128.0A ... 56.0A • 128.0A ... 112.0A • 128.0A ... 224.0A <p>If: CT . CT Type = W5 : 128 A ... 448 A</p> <ul style="list-style-type: none"> • 128.0A ... 448.0A • 128.0A ... 896.0A • 128.0A ... 10000.0A • 256.0A ... 0A • 256.0A ... 56.0A • 256.0A ... 56.0A • 256.0A ... 112.0A • 256.0A ... 224.0A • 256.0A ... 448.0A <p>If: CT . CT Type = W6 : 256 A ... 896 A</p> <ul style="list-style-type: none"> • 256.0A ... 896.0A • 256.0A ... 10000.0A



4 Field settings

4.1.2 CT: Direct Controls



CT . CT pri	[Field Para / CT]
	<ul style="list-style-type: none"> • 1A ... 0A • 1A ... 56.0A • 1A ... 56.0A • 1A ... 112.0A • 1A ... 224.0A • 1A ... 448.0A • 1A ... 896.0A If: CT . CT Type = Standard <ul style="list-style-type: none"> • 1A ... 10000.0A
	<i>Nominal current of the primary side of the current transformers.</i>

CT . ECT pri	[Field Para / CT]
60A	1A ... 10000.0A
Only available if:	
<ul style="list-style-type: none"> • Prot . Settings valid = Software 	
	<i>This parameter defines the primary nominal current of the connected earth current transformer. If the earth current is measured via the Holmgreen connection, the primary value of the phase current transformer must be entered here.</i>

CT . CT Shift by 0°/180°	[Field Para / CT]
0°	0°, 180°
	 Polarity
	<i>If this is set to 180° the phase current vectors are shifted by 180 degrees (change of sign), by device-internal calculation, i.e. without modification of the wiring.</i>

CT . ECT Shift by 0°/180°	[Field Para / CT]
0°	0°, 180°
Avail. depends on device type.	 Polarity
	<i>If this is set to 180° the ground current vector is shifted by 180 degrees (change of sign), by device-internal calculation, i.e. without modification of the wiring.</i>

4.1.2 CT: Direct Controls

CT . CT Type	[Field Para / CT]
Relative	Relative ... Standard
Only available if:	 CT Type
<ul style="list-style-type: none"> • Prot . Settings valid = Switches 	
	<i>Select the connected CT Type (for the display of primary or relative phase current values).</i>

CT . CT pri	[Field Para / CT]	
<p>0A</p> <p><i>Only available if:</i></p> <ul style="list-style-type: none"> • Prot . Settings valid = Switches 	<p>If: CT . CT Type = Relative</p> <ul style="list-style-type: none"> • 0A ... 0A • 0A ... 56.0A • 0A ... 56.0A • 0A ... 112.0A • 0A ... 224.0A • 0A ... 448.0A • 0A ... 896.0A • 0A ... 10000.0A • 16.0A ... 0A <p>If: CT . CT Type = WE2 : 16 A ... 56 A</p> <ul style="list-style-type: none"> • 16.0A ... 56.0A • 16.0A ... 56.0A • 16.0A ... 112.0A • 16.0A ... 224.0A • 16.0A ... 448.0A • 16.0A ... 896.0A • 16.0A ... 10000.0A • 16.0A ... 0A • 16.0A ... 56.0A <p>If: CT . CT Type = W2 : 16 A ... 56 A</p> <ul style="list-style-type: none"> • 16.0A ... 56.0A • 16.0A ... 112.0A • 16.0A ... 224.0A • 16.0A ... 448.0A • 16.0A ... 896.0A • 16.0A ... 10000.0A • 32.0A ... 0A • 32.0A ... 56.0A • 32.0A ... 56.0A <p>If: CT . CT Type = W3 : 32 A ... 112 A</p> <ul style="list-style-type: none"> • 32.0A ... 112.0A • 32.0A ... 224.0A • 32.0A ... 448.0A • 32.0A ... 896.0A • 32.0A ... 10000.0A • 64.0A ... 0A 	<p>P.1</p>

4 Field settings


4.1.2 CT: Direct Controls


CT . CT pri	[Field Para / CT]
	<ul style="list-style-type: none"> • 64.0A ... 56.0A • 64.0A ... 56.0A • 64.0A ... 112.0A <p>If: CT . CT Type = W4 : 64 A ... 224 A</p> <ul style="list-style-type: none"> • 64.0A ... 224.0A • 64.0A ... 448.0A • 64.0A ... 896.0A • 64.0A ... 10000.0A • 128.0A ... 0A • 128.0A ... 56.0A • 128.0A ... 56.0A • 128.0A ... 112.0A • 128.0A ... 224.0A <p>If: CT . CT Type = W5 : 128 A ... 448 A</p> <ul style="list-style-type: none"> • 128.0A ... 448.0A • 128.0A ... 896.0A • 128.0A ... 10000.0A • 256.0A ... 0A • 256.0A ... 56.0A • 256.0A ... 56.0A • 256.0A ... 112.0A • 256.0A ... 224.0A • 256.0A ... 448.0A <p>If: CT . CT Type = W6 : 256 A ... 896 A</p> <ul style="list-style-type: none"> • 256.0A ... 896.0A • 256.0A ... 10000.0A • 1A ... 0A • 1A ... 56.0A • 1A ... 56.0A • 1A ... 112.0A • 1A ... 224.0A • 1A ... 448.0A • 1A ... 896.0A <p>If: CT . CT Type = Standard</p> <ul style="list-style-type: none"> • 1A ... 10000.0A


© *Nominal current of the primary side of the current transformers.*


CT . ECT pri	[Field Para / CT]	
60A <i>Only available if:</i> • Prot . Settings valid = Switches	1A ... 10000.0A	P.1
☉	<i>This parameter defines the primary nominal current of the connected earth current transformer. If the earth current is measured via the Holmgreen connection, the primary value of the phase current transformer must be entered here.</i>	


4.1.3 CT: Values


CT . IL1	[Operation / Measured Values / Current]
 <i>Measured value: Phase current (fundamental)</i>	


CT . IL2	[Operation / Measured Values / Current]
 <i>Measured value: Phase current (fundamental)</i>	


CT . IL3	[Operation / Measured Values / Current]
 <i>Measured value: Phase current (fundamental)</i>	

CT . IG meas	[Operation / Measured Values / Current]
 <i>Avail. depends on device type.</i> <i>Measured value (measured): IG (fundamental)</i>	

CT . IG calc	[Operation / Measured Values / Current]
 <i>Measured value (calculated): IG (fundamental)</i> <i>Since the value might be unreliable or invalid for low phase currents it is displayed as "-0.0" in this case.</i>	




CT . phi IL1	[Operation / Measured Values / Current]
 <i>Measured value (calculated): Angle of Phasor IL1</i> <i>Since the angle might be unreliable or invalid for a too low amplitude it is displayed as 360° in this case.</i>	

CT . phi IL2	[Operation / Measured Values / Current]
 <i>Measured value (calculated): Angle of Phasor IL2</i> <i>Since the angle might be unreliable or invalid for a too low amplitude it is displayed as 360° in this case.</i>	

CT . phi IL3	[Operation / Measured Values / Current]
 <i>Measured value (calculated): Angle of Phasor IL3</i> <i>Since the angle might be unreliable or invalid for a too low amplitude it is displayed as 360° in this case.</i>	

4 Field settings

4.1.3 CT: Values

CT . phi IG meas	[Operation / Measured Values / Current]
 Avail. depends on device type. Measured value (calculated): Angle of Phasor IG meas Since the angle might be unreliable or invalid for a too low amplitude it is displayed as 360° in this case.	
CT . phi IG calc	[Operation / Measured Values / Current]
 Measured value (calculated): Angle of Phasor IG calc Since the angle might be unreliable or invalid for a too low amplitude it is displayed as 360° in this case.	
CT . IL1 H2	[Operation / Measured Values / Current]
 Measured value: 2nd harmonic/1st harmonic of IL1	
CT . IL2 H2	[Operation / Measured Values / Current]
 Measured value: 2nd harmonic/1st harmonic of IL2	
CT . IL3 H2	[Operation / Measured Values / Current]
 Measured value: 2nd harmonic/1st harmonic of IL3	
CT . IO	[Operation / Measured Values / Current]
 Measured value (calculated): Zero current (fundamental)	
CT . I1	[Operation / Measured Values / Current]
 Measured value (calculated): Positive phase sequence current (fundamental)	
CT . I2	[Operation / Measured Values / Current]
 Measured value (calculated): Unbalanced load current (fundamental)	
CT . %(I2/I1)	[Operation / Measured Values / Current]
 Measured value (calculated): I2/I1, phase sequence will be taken into account automatically.	
CT . IL1 RMS	[Operation / Measured Values / Current RMS]
 Measured value: Phase current (RMS)	
CT . IL2 RMS	[Operation / Measured Values / Current RMS]
 Measured value: Phase current (RMS)	
CT . IL3 RMS	[Operation / Measured Values / Current RMS]
 Measured value: Phase current (RMS)	

CT . IG meas RMS	[Operation / Measured Values / Current RMS]
✎	<p><i>Avail. depends on device type.</i></p> <p><i>Measured value (measured): IG (RMS)</i></p>
CT . IG calc RMS	[Operation / Measured Values / Current RMS]
✎	<p><i>Measured value (calculated): IG (RMS)</i></p> <p><i>Since the value might be unreliable or invalid for low phase currents it is displayed as "-0.0" in this case.</i></p>
CT . %IL1 THD	[Operation / Measured Values / Current RMS]
✎	<p><i>Measured value (calculated): IL1 Total Harmonic Distortion</i></p>
CT . %IL2 THD	[Operation / Measured Values / Current RMS]
✎	<p><i>Measured value (calculated): IL2 Total Harmonic Distortion</i></p>
CT . %IL3 THD	[Operation / Measured Values / Current RMS]
✎	<p><i>Measured value (calculated): IL3 Total Harmonic Distortion</i></p>

5 System

5.1 Time

Uptime

[Operation / Time / Uptime]





This item represents a special dialog. (See the Technical Manual for details.)


Display the operation time of the device


5.2 Sys - System

5.2.1 Sys: Direct Controls


Sys . Rst. Err. LED	[Operation / Reset]	
False	False, True ↳ True or not true	P.1
	<i>Direct Command to acknowledge a (device-internal) error. This also resets the System (Ready/Error) LED.</i>	


Sys . User Restart	[Service / General]	
False	False, True ↳ True or not true	P.1
	<i>Direct Command to manually initiate a warm restart of the device.</i>	


Sys . Factory Reset	[Service / General]	
False	False, True ↳ True or not true	P.1
	<i>Direct Command to reset all settings of the device to their respective default.</i>	

Sys . Force Backup Prot.	[Service / General]	
False	False, True ↳ True or not true	P.1
	<i>Direct Command to manually force the device into the Backup Protection mode. This disables all other protection, supervision and communication functions, so that it makes sense only for testing purposes (e.g. for testing Backup Protection during commissioning).</i>	

5.2.2 Sys: Values

Sys . Op. Hours	[Operation / Count and RevData / WIC1]	
	<i>Device operation hours counter, that shows for how long the device has been operating since the last restart.</i>	

Sys . Build	[Device Para / Version / WIC1] [Device Para / Version / DiggiMEC]	
	<i>Build Number</i>	

Sys . DM version	[Device Para / Version / WIC1]	
	<i>Version of the device model</i>	

5 System

5.2.2 Sys: Values

Sys . SW version	[Device Para / Version / WIC1]
 <i>Version of the device firmware</i>	
Sys . CAT No.	[Device Para / Version / WIC1]
 »CAT No.«, Order Code as printed on the nameplate of the device.	
Sys . REV.	[Device Para / Version / WIC1]
 <i>Revision (as printed on the nameplate of the device).</i>	
Sys . S/N	[Device Para / Version / WIC1]
 <i>The serial number of the device.</i>	
Sys . DM version	[Device Para / Version / DiggiMEC]
 <i>Version of the device model</i>	
Sys . SW version	[Device Para / Version / DiggiMEC]
 <i>Version of the device firmware</i>	
Sys . CAT No.	[Device Para / Version / DiggiMEC]
 »CAT No.«, Order Code as printed on the nameplate of the device.	
Sys . REV.	[Device Para / Version / DiggiMEC]
 <i>Revision (as printed on the nameplate of the device).</i>	
Sys . S/N	[Device Para / Version / DiggiMEC]
 <i>The serial number of the device.</i>	


6 Measured Values

- CT - Current Transformer: [↪](#) “4.1.3 CT: Values”
- Sys - System: [↪](#) “5.2.2 Sys: Values”
- Peak Current Ptr - Statistic of the current measuring values: [↪](#) “7.1.3 Peak Current Ptr: Values”
- Life Load - Load Current Histogram: [↪](#) “7.2.6 Life Load: Values”
- Modbus: [↪](#) “8.1.4 Modbus: Values”
- Protection Parameter: [↪](#) “9.6 Prot: Values”
- ThR - Thermal replica module: [↪](#) “9.15.6 ThR: Values”
- BkrWear - Breaker Wear: [↪](#) “9.22.2.5 BkrWear: Values”


7 Statistics

7.1 Peak Current Ptr – Statistic of the current measuring values



7.1.1 Peak Current Ptr: Settings

Peak Current Ptr . Time win. for calc. avg.	[Protection Para / Condition Monitoring / Peak Current Ptr]	
15 min	1 min, 8 min, 15 min, 20 min ↳ Time win. for calc. avg.	P.1
	<i>Select the time-window for calculating average values</i>	

7.1.2 Peak Current Ptr: Direct Controls


Peak Current Ptr . Clear	[Operation / Reset]	
Inactive	Inactive, Active ↳ Mode	P.1
	<i>Direct Command to reset the drag indicator for »Imax«</i>	

7.1.3 Peak Current Ptr: Values


Peak Current Ptr . Imax	[Operation / Condition Monitoring / Peak Current Ptr (Val.)]	
	<i>Maximum value of the averaged phase current »Iavg« since the last reset</i>	
Peak Current Ptr . Iavg	[Operation / Condition Monitoring / Peak Current Ptr (Val.)]	
	<i>Maximum value of the phase current, time-averaged over the set time-window</i> <i>As long as the displayed value of »Iavg« is not significant yet, because the calculation is ongoing, the value is displayed as "-0.0". (After the set time window has elapsed a valid value is displayed.)</i>	


7.2 Life Load - Load Current Histogram


7.2.1 Life Load: Device Planning Parameters

Life Load . Mode	[Device planning / Projected Elements]	
use	“-”, use ↳ Device planning	P.1
	Load Current Histogram, general operation mode	


7.2.2 Life Load: Settings

Life Load . Function	[Protection Para / Condition Monitoring / Life Load]	
Inactive	Inactive, Active ↳ Mode	P.1
	Permanent activation or deactivation of module/stage.	


Life Load . I	[Protection Para / Condition Monitoring / Life Load]	
> 1.0 In In	> 0.4 In In ... > 1.2 In In ↳ I	P.1
	The sum of operating times in current ranges above this value is monitored.	

Life Load . Threshold t	[Protection Para / Condition Monitoring / Life Load]	
1.00d	0.01d ... 1000.00d	P.1
	An alarm is issued if the sum of operating times in current ranges above »I« exceeds this time threshold.	


7.2.3 Life Load: Direct Controls


Life Load . Rst. Alarm	[Operation / Reset]	
Inactive	Inactive, Active ↳ Mode	P.1
	Direct Command to reset the Alarm signal. This also resets the countdown timer »Time to Alarm« back to the setting value »Threshold t«.	

7.2.4 Life Load: Input States


Life Load . Assign_1_	Not in menu tree, only: Event recorder
 Assignment 1 example_	


7.2.5 Life Load: Signals (Output States)


Life Load . Active	[Operation / Status Display / All Actives] [Operation / Status Display / Life Load]
 Signal: active	


Life Load . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / Life Load]
 Signal: Alarm	

7.2.6 Life Load: Values

Life Load . < 0.4 In	[Operation / Condition Monitoring / Life Load (Values)]
 Number of operating days with measured current values within this range	

Life Load . 0.4 ... 0.5 In	[Operation / Condition Monitoring / Life Load (Values)]
...	
Life Load . 1.1 ... 1.2 In	
 Number of operating days with measured current values within this range	


Life Load . > 1.2 In	[Operation / Condition Monitoring / Life Load (Values)]
 Number of operating days with measured current values within this range	

Life Load . Time to Alarm	[Operation / Condition Monitoring / Life Load (Values)]
 Time (displayed in days) until an alarm signal is issued, because the device has been connected to too high phase currents for a too long time. (The time counts backwards from the »Threshold t« setting to 0. The Direct Command »Rst. Alarm« sets it back to »Threshold t«.)	


8 Communication


8.1 Modbus


8.1.1 Modbus: Device Planning Parameters


Modbus . Mode		[Device planning / Projected Elements]
RTU	“-”, RTU ↳ Mode	P.1
 <i>Modbus Protocol, general operation mode</i>		

8.1.2 Modbus: Settings

Modbus . Allow invalid addr.		[Device Para / Modbus / General]
Send an exception	Send an exception, Inv. addr. are allowed ↳ Allow invalid addr.	P.1
 <i>Select the rule how the device shall handle the query for an invalid start address (or an address range with internal “gaps”).</i>		

Modbus . Baud rate		[Device Para / Modbus / RTU]
9600 <i>Avail. depends on device type.</i>	1200, 2400, 4800, 9600, 19200, 38400 ↳ Baud rate	P.1
 <i>Baud rate</i>		

Modbus . Physical Settings		[Device Para / Modbus / RTU]
8E1 <i>Avail. depends on device type.</i>	8E1, 8O1, 8N1, 8N2 ↳ Physical Settings	P.1
 <i>Digit 1: Number of bits. Digit 2: E=even parity, O=odd parity, N=no parity. Digit 3: Number of stop bits. More information on the parity: It is possible that the last data bit is followed by a parity bit which is used for recognition of communication errors. The parity bit ensures that with even parity (“EVEN”) always an even number of bits with valence “1” or with odd parity (“ODD”) an odd number of “1” valence bits are transmitted. But it is also possible to transmit no parity bits (here the setting is “Parity = None”). More information on the stop-bits: The end of a data byte is terminated by the stop-bits.</i>		

Modbus . Modbus TCP Port Number		[Device Para / Modbus / TCP/IP]
502 <i>Avail. depends on device type.</i>	502 ... 65535	P.1
 <i>TCP port number to be used for Modbus TCP.</i> <i>In general it is recommended to keep the default value. If this is not possible then select a number out of the private range 49152-52151 or 52164-65535 that is not yet in use within your network.</i>		

8.1.3 Modbus: Direct Controls

Modbus . Rst. Counters	[Operation / Reset]	
Inactive	Inactive, Active Mode	P.1
<i>Direct Command to reset all Modbus Diagnosis Counters</i>		

Modbus . Slave ID	[Device Para / Modbus / RTU]	
1	1 ... 247	P.1
<i>Device address (Slave ID) within the bus system. Each device address has to be unique within a bus system.</i>		

8.1.4 Modbus: Values

Modbus . Comm.err.	[Operation / Count and RevData / Modbus / RTU]	
<i>Grand total number of communication errors</i>		

Modbus . RX msg.	[Operation / Count and RevData / Modbus / RTU]	
<i>Number of received messages / telegrams (since the last reset)</i>		

Modbus . Req.for me	[Operation / Count and RevData / Modbus / RTU]	
<i>Total Number of requests for this slave.</i>		


Modbus . TX msg.	[Operation / Count and RevData / Modbus / RTU]	
<i>Number of transmitted messages / telegrams (since the last reset)</i>		

Modbus . RX chars	[Operation / Count and RevData / Modbus / RTU]	
<i>RX chars</i>		


Modbus . TX chars	[Operation / Count and RevData / Modbus / RTU]	
<i>Number of transmitted characters (since the last reset)</i>		


9 Protection Parameter


9.1 Prot: Device Planning Parameters


Prot . Settings valid	[Device planning / WIC1 + DiggiMEC]
	<p>If: Device Variant with DIP/HEX Switches = 50 Hz / 60 Hz P.1</p> <ul style="list-style-type: none"> • Software • Software • Switches, Software <p>If: Device Variant with DIP/HEX Switches ≠ 50 Hz / 60 Hz</p> <ul style="list-style-type: none"> • Switches, Software <p>↪ Settings valid</p>
<p> <i>Select which settings shall be valid: the settings made via Smart view/DiggiMEC or the switches on the housing.</i></p> <p><i>(If set to "Switches", then the respective default values are always used for all settings that are not associated with any switch.)</i></p> <p><i>Note that getting back from "Software" to "Switches" is not possible with this parameter, you have to execute a Reset to Factory Defaults instead!</i></p>	

9.2 Prot: Settings


Prot . Out. Mode	[Device Para / WIC1 / Output]
Impulse Output	<p>If: Dual-Powered Device Variant = True P.1</p> <ul style="list-style-type: none"> • Impulse Output, Syst. O.K. & Ext.Suppl. • Impulse Output • Impulse Output, Syst. O.K. & Ext.Suppl. <p>If: Dual-Powered Device Variant = False</p> <ul style="list-style-type: none"> • Impulse Output <p>↪ Out. Mode</p>
<p> <i>Select whether the output shall operate as an impulse output (for connecting a flag indicator with full compatibility to the 1st generation WIC1), or as a relay output (with a fixed, pre-defined usage as a self-supervision contact).</i></p> <p><i>(The usage as a self-supervision contact is only possible with an externally supplied WIC1-4, and connecting a flag indicator is not permissible with this setting.)</i></p>	


Prot . Out. assign.	[Device Para / WIC1 / Output]	
<p><i>Only available if:</i></p> <ul style="list-style-type: none"> Prot . Out. Mode \neq Syst. O.K. & Ext.Suppl. 	<p>If: Device Variant/Outputs = TC: TripCmd</p> <ul style="list-style-type: none"> “-” “-” ... Prot . TripCmd “-” ... Prot . Pos OFF <p>If: Device Variant/Outputs = TC: TripCmd, FI: TripCmd</p> <ul style="list-style-type: none"> Prot . TripCmd Prot . TripCmd ... Prot . Pos OFF “-” “-” ... Prot . TripCmd <p>If: Device Variant/Outputs = TC: TripCmd, FI: configurable</p> <ul style="list-style-type: none"> “-” ... Prot . Pos OFF <p>↪</p>	P.1
	<p><i>Assign the signal that shall activate the output.</i></p> <p><i>(If the output is set as impulse output the signal triggers the impulses for the connected Flag Indicator. If it is set as relay output the signal sets it to the “active” state.)</i></p>	


Prot . Out. Inverting	[Device Para / WIC1 / Output]	
<p>Inactive</p> <p><i>Only available if:</i></p> <ul style="list-style-type: none"> Prot . Out. Mode \neq Syst. O.K. & Ext.Suppl. 	<p>Inactive, Active</p> <p>↪ Mode</p>	P.1
	<p><i>Inverting of the signal that has been assigned to the output.</i></p>	

Prot . Nom voltage	[Device Para / WIC1 / Digital Inputs]	
	<p>If: Dual-Powered Device Variant = True</p> <ul style="list-style-type: none"> 24 VDC, 48 VDC ... 60 VDC, 110 VDC, 230 VDC, 110 VAC, 230 VAC 24 VDC, 48 VDC ... 60 VDC, 110 VDC, 230 VDC, 110 VAC, 230 VAC, 115 VAC / 230 VAC <p>If: Dual-Powered Device Variant = False</p> <ul style="list-style-type: none"> 115 VAC / 230 VAC <p>↪ Nom voltage</p>	P.1
	<p><i>Nominal voltage of the digital inputs</i></p>	

Prot . Assign Ext. Reset	[Device Para / Reset]	
	<p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> “-” “-” “-” 	P.1



Prot . Assign Ext. Reset	[Device Para / Reset]
	<ul style="list-style-type: none"> • “-”, Prot . DI 1 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “_” <p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> • “_” • “_” • “-”, Prot . DI 1 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip</p> <ul style="list-style-type: none"> • “_” • “-”, Prot . DI 1 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 <p>If: Device Variant/Inputs = Ext. Trip, Ext. Reset</p> <ul style="list-style-type: none"> • Prot . DI 1 • Prot . DI 1, Prot . DI 2 • Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “-”, Prot . DI 1 <p>If: Device Variant/Inputs = Configurable</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “-”, Prot . DI 1 • “-”, Prot . DI 1, Prot . DI 2 <p>If: Device Variant/Inputs = Configurable Inputs</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 <p></p>

 Assign an digital input signal that, when it becomes true, will reset all latched LEDs, all DiggiMEC Flag Indicators, and a fault/trip info that might be visible on the DiggiMEC display.



Prot . Aux ON	[Protection Para / Breaker & Trip]
	<ul style="list-style-type: none"> • “_” <p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip, Ext. Reset</p> <ul style="list-style-type: none"> • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “_” <p>If: Device Variant/Inputs = Configurable</p> <ul style="list-style-type: none"> • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “_” • “_” • “_” <p>If: Device Variant/Inputs = Configurable Inputs</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 <p></p>



 The CB is in ON-position if the state of the assigned signal is true (52a).

Prot . Aux OFF	[Protection Para / Breaker & Trip]	
<p><i>Only available if:</i></p> <ul style="list-style-type: none"> • Prot . Meth.Detect.Bkr.Pos. = Aux-Based • Prot . Meth.Detect.Bkr.Pos. = Current and Aux 	<p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” <p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip, Ext. Reset</p> <ul style="list-style-type: none"> • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “_” <p>If: Device Variant/Inputs = Configurable</p> <ul style="list-style-type: none"> • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” 	P.1



Prot . Aux OFF	[Protection Para / Breaker & Trip]
	<ul style="list-style-type: none"> • “_” • “_” • “_” <p>If: Device Variant/Inputs = Configurable Inputs</p> <ul style="list-style-type: none"> • “_”, Prot . DI 1, Prot . DI 2 <p></p>
	<i>The CB is in OFF-position if the state of the assigned signal is true (52b).</i>



Prot . SCmd ON	[Protection Para / Breaker & Trip]
	<p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “_” • “_”, Prot . DI 1, Prot . DI 2 • “_”, Prot . DI 1, Prot . DI 2 • “_” <p>If: Device Variant/Inputs = Without Inputs</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “_”, Prot . DI 1, Prot . DI 2 • “_”, Prot . DI 1, Prot . DI 2 • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip</p> <ul style="list-style-type: none"> • “_” • “_” • “_”, Prot . DI 1, Prot . DI 2 • “_”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip, Ext. Reset</p> <ul style="list-style-type: none"> • “_” • “_”, Prot . DI 1, Prot . DI 2 • “_”, Prot . DI 1, Prot . DI 2 • “_”
	P.1

Prot . SCmd ON	[Protection Para / Breaker & Trip]
	<ul style="list-style-type: none"> • “-” • “-” • “-” <p>If: Device Variant/Inputs = Configurable</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-” • “-” • “-” • “-” • “-”, Prot . DI 1, Prot . DI 2 <p>If: Device Variant/Inputs = Configurable Inputs</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 <p></p>
	<i>Switching ON Command, e.g. the state of the digital input</i>

Prot . ExBlo TripCmd	[Protection Para / Breaker & Trip]
“-”	<p>“-” ... Prot . Pos OFF</p> <p></p>
	P.1
	<i>If external blocking of the tripping command is activated (allowed), the tripping command of the entire device will be blocked if the state of the assigned signal becomes true.</i>


9.3 Prot: Direct Controls


Prot . Rst. LEDs, FIs	[Operation / Reset]
False	<p>False, True</p> <p> True or not true</p>
	P.1
	<i>Direct Command to immediately reset all latched LEDs, all DiggiMEC Flag Indicators, and the Fault Info Screen that might be visible on the DiggiMEC display.</i>


Prot . Rst. Fault Records	[Operation / Reset]
False	<p>False, True</p> <p> True or not true</p>
	P.1
	<i>Direct Command to immediately delete all entries from the Fault Recorder.</i>

9 Protection Parameter


9.4 Prot: Input States

Prot . Rst. Fault No.	[Operation / Reset]	
False	False, True ↳ True or not true	P.1
	<i>Direct Command to Reset the Fault number</i>	


Prot . Force Trip Cmd	[Service / Prot]	
Inactive	Inactive, Active ↳ Mode	P.1
	<p><i>Direct Command to force the device to issue a trip command (for testing purposes). This has the following additional effects:</i></p> <ul style="list-style-type: none"> - The signals »Prot . Pickup«, »Prot . Trip« and »Prot . TripCmd« are set. - A fault record is created. - The breaker failure protection is triggered. - An automatic reset is executed. 	


Prot . Force FI Pulse	[Service / Prot]	
Inactive	Inactive, Active ↳ Mode	P.1
	<i>Direct Command to force an impulse at the FI output of the WIC1 (for testing purposes).</i>	

9.4 Prot: Input States

Prot . ExBlo TripCmd-I	[Operation / Status Display / Prot]	
	<i>Module input state: External Blocking of the Trip Command</i>	

9.5 Prot: Signals (Output States)











Prot . Active	[Operation / Status Display / All Actives] [Operation / Status Display / Prot]	
	<i>Signal: active</i>	

Prot . Trip	[Operation / Status Display / Trips] [Operation / Status Display / Prot]	
	<i>Signal: General Trip</i>	


Prot . TripCmd	[Operation / Status Display / Trips] [Operation / Status Display / Prot]
↑ Signal: Trip Command	
Prot . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / Prot]
↑ Signal: General Alarm	
Prot . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / Prot]
↑ Signal: General Pickup	
Prot . Trip IPh	[Operation / Status Display / Prot]
↑ Signal: General Trip due to a phase current fault	
Prot . Trip IG	[Operation / Status Display / Prot]
↑ Signal: General Trip due to a ground current fault	
Prot . Trip Ext.	[Operation / Status Display / Prot]
↑ Avail. depends on device type. Signal: General Trip due to an external signal	
Prot . Trip IL1	[Operation / Status Display / Prot]
↑ Signal: General Trip due to a fault in phase L1	
Prot . Trip IL2	[Operation / Status Display / Prot]
↑ Signal: General Trip due to a fault in phase L2	
Prot . Trip IL3	[Operation / Status Display / Prot]
↑ Signal: General Trip due to a fault in phase L3	
Prot . Pickup I Ph	[Operation / Status Display / Prot]
↑ Signal: General Pickup due to a phase current fault	
Prot . Pickup IG	[Operation / Status Display / Prot]
↑ Signal: General Pickup due to a ground current fault	

9 Protection Parameter

9.5 Prot: Signals (Output States)


Prot . Pickup Ext.	[Operation / Status Display / Prot]
 Avail. depends on device type. Signal: General Pickup due to an external signal	
Prot . Pickup IL1	[Operation / Status Display / Prot]
 Signal: General Pickup due to a fault in phase L1	
Prot . Pickup IL2	[Operation / Status Display / Prot]
 Signal: General Pickup due to a fault in phase L2	
Prot . Pickup IL3	[Operation / Status Display / Prot]
 Signal: General Pickup due to a fault in phase L3	
Prot . Pos ON	[Operation / Status Display / Prot]
 Signal: Circuit Breaker is in ON-Position	
Prot . Pos OFF	[Operation / Status Display / Prot]
 Signal: Circuit Breaker is in OFF-Position	
Prot . ON Cmd	[Operation / Status Display / Prot]
 Signal: ON command issued to the breaker	
Prot . Syst. OK. & Ext.Suppl.	[Operation / Status Display / Prot]
 Avail. depends on device type. Signal: The WIC1 is running and is supplied by external auxiliary power and has loaded sufficient electrical energy for triggering the trip impulse output.	
Prot . -	Not in menu tree, only: Event recorder
 none	
Prot . DI 1	[Operation / Status Display / Prot]
Prot . DI 2	
 Avail. depends on device type. Signal: Digital Input	

9.6 Prot: Values


Prot . Fault No.	[Operation / Count and RevData / Prot]
	<i>Fault number</i>


9.7 IH2 – Module Inrush


9.7.1 IH2: Device Planning Parameters


IH2 . Mode		[Device planning / Projected Elements]
use	“-”, use ↳ Device planning	P.1
	<i>Module Inrush, general operation mode</i>	


9.7.2 IH2: Settings

IH2 . Function		[Protection Para / IH2]
Active	Inactive, Active ↳ Mode	P.1
	<i>Permanent activation or deactivation of module/stage.</i>	

IH2 . IH2 / IH1		[Protection Para / IH2]
20%	15% ... 40%	P.1
	<i>Maximum permissible percentage of the 2nd harmonic of the 1st harmonic.</i>	

IH2 . I_{max}		[Protection Para / IH2]
6.00I _n	1.0I _n ... 20.0I _n	P.1
	<i>Inrush limit value: If the phase current is above this value the inrush blocking is cancelled.</i>	

IH2 . t_{max}		[Protection Para / IH2]
0.3s	0.1s ... 999.99s	P.1
	<i>Maximum duration (phase-selective) of an inrush blocking</i>	


IH2 . 3-ph Blo		[Protection Para / IH2]
Inactive	Inactive, Active ↳ Mode	P.1
	<i>Activation of 3-phase inrush blocking: If an inrush is detected in (at least) one phase all three phases get blocked. (If this is inactive then only the Inrush-affected phase gets blocked.)</i>	


9.7.3 IH2: Signals (Output States)

IH2 . Active	[Operation / Status Display / All Actives] [Operation / Status Display / IH2]
↑ Signal: <i>active</i>	
IH2 . Block. L1	[Operation / Status Display / IH2]
↑ Signal: <i>Inrush blocking of phase L1 of the phase overcurrent protection</i>	
IH2 . Block. L2	[Operation / Status Display / IH2]
↑ Signal: <i>Inrush blocking of phase L2 of the phase overcurrent protection</i>	
IH2 . Block. L3	[Operation / Status Display / IH2]
↑ Signal: <i>Inrush blocking of phase L3 of the phase overcurrent protection</i>	
IH2 . Block. Ph.	[Operation / Status Display / IH2]
↑ Signal: <i>Inrush blocking of a phase of the phase overcurrent protection</i>	
IH2 . Block. 3-ph	[Operation / Status Display / IH2]
↑ Signal: <i>3-phase Inrush blocking: An inrush has been detected in (at least) one phase, so that all three phases are blocked.</i>	
IH2 . Imax exceeded	[Operation / Status Display / IH2]
↑ Signal: <i>The Inrush limit value has been exceeded, so that the inrush blocking has been cancelled.</i>	
IH2 . tmax elapsed	[Operation / Status Display / IH2]
↑ Signal: <i>The (phase-selective) maximum duration of an inrush blocking has been reached, so that the inrush blocking has been stopped.</i>	


9.8 I> - Phase Overcurrent Stage


9.8.1 I>: Device Planning Parameters


I> . Mode	[Device planning / Projected Elements]	
use	“-”, use ↳ Device planning	P.1
	<i>Phase Overcurrent Stage, general operation mode</i>	

I> . Definition	[Device planning / Definition]	
Trip	Trip, Alarm ↳ Definition	P.1
	<i>Phase Overcurrent Stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>	

9.8.2 I>: Settings


I> . Function	[Protection Para / I>]	
Active	Inactive, Active ↳ Mode	P.1
	<i>Permanent activation or deactivation of module/stage.</i>	


I> . I	[Protection Para / I>]	
1.00In	If: I> . Char = DEFT <ul style="list-style-type: none"> • 0.35In ... 20.00In If: I> . Char = IEC NINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = IEC VINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = IEC EINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = IEC LINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = RINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = HV Fuse <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = FR Fuse <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = IEEE MINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = IEEE VINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = IEEE EINV <ul style="list-style-type: none"> • 0.35In ... 2.50In If: I> . Char = EF Curve <ul style="list-style-type: none"> • 0.35In ... 2.50In 	P.1
	<p>If the pickup value is exceeded, the protection stage starts to time out to trip.</p> <p>WARNING: Check the Technical Data and ensure that the actual overcurrent settings for this pickup threshold and the trip delay comply with the technical limits of the phase current inputs! (The device allows for overcurrent settings that are out of the permitted range of current values.)</p>	


I> . Char	[Protection Para / I>]	
DEFT	DEFT ... EF Curve ↳ Char	P.1
	Characteristic	

9 Protection Parameter


9.8.2 I>: Settings


I> . t	[Protection Para / I>]	
0.1s <i>Only available if:</i> • I> . Char = DEFT	0.00s ... 300.00s	P.1
 Time delay for trip or alarm		


I> . tChar	[Protection Para / I>]	
0.1 <i>Only available if:</i> • I> . Char = IEC NINV • I> . Char = IEC VINV • I> . Char = IEC EINV • I> . Char = IEC LINV • I> . Char = RINV • I> . Char = HV Fuse • I> . Char = FR Fuse • I> . Char = IEEE MINV • I> . Char = IEEE VINV • I> . Char = IEEE EINV • I> . Char = EF Curve	0.05 ... 10.00	P.1
 Time multiplier/tripping characteristic factor. The setting range depends on the selected tripping curve.		


I> . tMin	[Protection Para / I>]	
0.00s <i>Only available if:</i> • I> . Char = IEC NINV • I> . Char = IEC VINV • I> . Char = IEC EINV • I> . Char = IEC LINV • I> . Char = RINV • I> . Char = HV Fuse • I> . Char = FR Fuse • I> . Char = IEEE MINV • I> . Char = IEEE VINV • I> . Char = IEEE EINV • I> . Char = EF Curve	0.00s ... 20.00s	P.1
 Minimum trip delay time. Independent of the measured current values, the trip delay time does never fall below the minimum that is set here.		

I> . Reset Mode	[Protection Para / I>]	
instantaneous	If: I> . Char = DEFT <ul style="list-style-type: none"> instantaneous, definite time If: I> . Char = IEC NINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = IEC VINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = IEC EINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = IEC LINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = RINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = HV Fuse <ul style="list-style-type: none"> instantaneous, definite time If: I> . Char = FR Fuse <ul style="list-style-type: none"> instantaneous, definite time If: I> . Char = IEEE MINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = IEEE VINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = IEEE EINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I> . Char = EF Curve <ul style="list-style-type: none"> instantaneous, definite time ↪ Reset Mode	P.1
	<i>Reset Mode</i>	


I> . tReset	[Protection Para / I>]	
0.1s <i>Only available if:</i> <ul style="list-style-type: none">I> . Reset Mode = definite time	0.00s ... 60.00s	P.1
	<i>Reset delay for intermittent phase failures (INV characteristics only)</i>	

I> . IH2 Blo	[Protection Para / I>]	
Active	If: IH2 . Mode = use <ul style="list-style-type: none"> • Inactive, Active If: IH2 . Mode = "-" <ul style="list-style-type: none"> • Inactive Mode	P.1
	Blocking the trip command, if an inrush is detected.	


I> . Stab. by CLPU	[Protection Para / I>]	
Inactive	Inactive, Active	P.1
Only available if:	Mode	
	<ul style="list-style-type: none"> • CLPU . Mode = use 	
	Select whether the CLPU stabilization shall be effective for this protection stage. (If set to "active" then further settings are available within the CLPU menu.)	


I> . ExBlo	[Protection Para / I>]	
"-"	"-" ... Prot . Pos OFF	P.1
	Mode	
	External blocking of the module if the state of the assigned signal is true.	

9.8.3 I>: Input States

I> . ExBlo-I	[Operation / Status Display / I>]	
	Module input state: External blocking	

9.8.4 I>: Signals (Output States)






I> . Active	[Operation / Status Display / All Actives]	
	[Operation / Status Display / I>]	
	Signal: active	

I> . Trip	[Operation / Status Display / Trips]	
	[Operation / Status Display / I>]	
	Only available if: <ul style="list-style-type: none"> • I> . Definition = Trip Signal: Trip	

I> . Alarm		[Operation / Status Display / Alarms] [Operation / Status Display / I>]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • I> . Definition = Alarm <i>Signal: Alarm</i>	
I> . Pickup		[Operation / Status Display / Pickups] [Operation / Status Display / I>]
↑	<i>Signal: Pickup</i>	
I> . Trip IL1		[Operation / Status Display / I>]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • I> . Definition = Trip <i>Signal: Trip due to a fault in phase L1</i>	
I> . Trip IL2		[Operation / Status Display / I>]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • I> . Definition = Trip <i>Signal: Trip due to a fault in phase L2</i>	
I> . Trip IL3		[Operation / Status Display / I>]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • I> . Definition = Trip <i>Signal: Trip due to a fault in phase L3</i>	
I> . Alarm IL1		[Operation / Status Display / I>]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • I> . Definition = Alarm <i>Signal: Alarm due to a fault in phase L1</i>	
I> . Alarm IL2		[Operation / Status Display / I>]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • I> . Definition = Alarm <i>Signal: Alarm due to a fault in phase L2</i>	


9 Protection Parameter


9.8.4 I>: Signals (Output States)

I> . Alarm IL3	[Operation / Status Display / I>]
 Only available if: <ul style="list-style-type: none">• I> . Definition = Alarm Signal: Alarm due to a fault in phase L3	
I> . Pickup IL1	[Operation / Status Display / I>]
 Signal: Pickup in phase L1	
I> . Pickup IL2	[Operation / Status Display / I>]
 Signal: Pickup in phase L2	
I> . Pickup IL3	[Operation / Status Display / I>]
 Signal: Pickup in phase L3	
I> . IH2 Blo	[Operation / Status Display / I>]
 Signal: Blocking the trip command by an inrush	


9.9 I>> - Phase Overcurrent Stage

9.9.1 I>>: Device Planning Parameters

I>> . Mode		[Device planning / Projected Elements]
use	“-”, use ↳ Device planning	P.1
 <i>Phase Overcurrent Stage, general operation mode</i>		


I>> . Definition		[Device planning / Definition]
Trip	Trip, Alarm ↳ Definition	P.1
 <i>Phase Overcurrent Stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>		


9.9.2 I>>: Settings


I>> . Function		[Protection Para / I>>]
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


9 Protection Parameter


9.9.2 I>>: Settings

I>> . I	[Protection Para / I>>]	
1.00In	If: I>> . Char = DEFT • 0.35In ... 20.00In If: I>> . Char = IEC NINV • 0.35In ... 2.50In If: I>> . Char = IEC VINV • 0.35In ... 2.50In If: I>> . Char = IEC EINV • 0.35In ... 2.50In If: I>> . Char = IEC LINV • 0.35In ... 2.50In If: I>> . Char = RINV • 0.35In ... 2.50In If: I>> . Char = HV Fuse • 0.35In ... 2.50In If: I>> . Char = FR Fuse • 0.35In ... 2.50In If: I>> . Char = IEEE MINV • 0.35In ... 2.50In If: I>> . Char = IEEE VINV • 0.35In ... 2.50In If: I>> . Char = IEEE EINV • 0.35In ... 2.50In If: I>> . Char = EF Curve • 0.35In ... 2.50In	P.1
<p> <i>If the pickup value is exceeded, the protection stage starts to time out to trip.</i></p> <p><i>WARNING: Check the Technical Data and ensure that the actual overcurrent settings for this pickup threshold and the trip delay comply with the technical limits of the phase current inputs! (The device allows for overcurrent settings that are out of the permitted range of current values.)</i></p>		

I>> . Char	[Protection Para / I>>]	
DEFT	DEFT ... EF Curve ↳ Char	P.1
<p> <i>Characteristic</i></p>		

I>> . t	[Protection Para / I>>]	
0.1s <i>Only available if:</i> • I>> . Char = DEFT	0.00s ... 300.00s	P.1
 Time delay for trip or alarm		

I>> . tChar	[Protection Para / I>>]	
0.1 <i>Only available if:</i> • I>> . Char = IEC NINV • I>> . Char = IEC VINV • I>> . Char = IEC EINV • I>> . Char = IEC LINV • I>> . Char = RINV • I>> . Char = HV Fuse • I>> . Char = FR Fuse • I>> . Char = IEEE MINV • I>> . Char = IEEE VINV • I>> . Char = IEEE EINV • I>> . Char = EF Curve	0.05 ... 10.00	P.1
 Time multiplier/tripping characteristic factor. The setting range depends on the selected tripping curve.		


I>> . tMin	[Protection Para / I>>]	
0.00s <i>Only available if:</i> • I>> . Char = IEC NINV • I>> . Char = IEC VINV • I>> . Char = IEC EINV • I>> . Char = IEC LINV • I>> . Char = RINV • I>> . Char = HV Fuse • I>> . Char = FR Fuse • I>> . Char = IEEE MINV • I>> . Char = IEEE VINV • I>> . Char = IEEE EINV • I>> . Char = EF Curve	0.00s ... 20.00s	P.1
 Minimum trip delay time. Independent of the measured current values, the trip delay time does never fall below the minimum that is set here.		


I>> . Reset Mode	[Protection Para / I>>]	
instantaneous	If: I>> . Char = DEFT • instantaneous, definite time If: I>> . Char = IEC NINV • instantaneous, definite time, inverse time If: I>> . Char = IEC VINV • instantaneous, definite time, inverse time If: I>> . Char = IEC EINV • instantaneous, definite time, inverse time If: I>> . Char = IEC LINV • instantaneous, definite time, inverse time If: I>> . Char = RINV • instantaneous, definite time, inverse time If: I>> . Char = HV Fuse • instantaneous, definite time If: I>> . Char = FR Fuse • instantaneous, definite time If: I>> . Char = IEEE MINV • instantaneous, definite time, inverse time If: I>> . Char = IEEE VINV • instantaneous, definite time, inverse time If: I>> . Char = IEEE EINV • instantaneous, definite time, inverse time If: I>> . Char = EF Curve • instantaneous, definite time ↪ Reset Mode	P.1


 *Reset Mode*

I>> . tReset	[Protection Para / I>>]	
0.1s <i>Only available if:</i> • I>> . Reset Mode = definite time	0.00s ... 60.00s	P.1


 *Reset delay for intermittent phase failures (INV characteristics only)*

I>> . IH2 Blo	[Protection Para / I>>]	
Active	If: IH2 . Mode = use <ul style="list-style-type: none"> Inactive, Active If: IH2 . Mode = “-” <ul style="list-style-type: none"> Inactive Mode	P.1
	<i>Blocking the trip command, if an inrush is detected.</i>	


I>> . Stab. by CLPU	[Protection Para / I>>]	
Inactive	Inactive, Active	P.1
Only available if:	Mode	
	<ul style="list-style-type: none"> CLPU . Mode = use 	
	<i>Select whether the CLPU stabilization shall be effective for this protection stage. (If set to “active” then further settings are available within the CLPU menu.)</i>	


I>> . ExBlo	[Protection Para / I>>]	
“-”	“-” ... Prot . Pos OFF	P.1
	Mode	
	<i>External blocking of the module if the state of the assigned signal is true.</i>	

9.9.3 I>>: Input States

I>> . ExBlo-I	[Operation / Status Display / I>>]	
	<i>Module input state: External blocking</i>	

9.9.4 I>>: Signals (Output States)

I>> . Active	[Operation / Status Display / All Actives]	
	[Operation / Status Display / I>>]	
	<i>Signal: active</i>	

I>> . Trip	[Operation / Status Display / Trips]	
	[Operation / Status Display / I>>]	
	<i>Only available if:</i> <ul style="list-style-type: none"> I>> . Definition = Trip <i>Signal: Trip</i>	

9 Protection Parameter


9.9.4 I>>: Signals (Output States)


I>> . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / I>>]
 Only available if: <ul style="list-style-type: none">• I>> . Definition = Alarm Signal: Alarm	
I>> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / I>>]
 Signal: Pickup	
I>> . Trip IL1	[Operation / Status Display / I>>]
 Only available if: <ul style="list-style-type: none">• I>> . Definition = Trip Signal: Trip due to a fault in phase L1	
I>> . Trip IL2	[Operation / Status Display / I>>]
 Only available if: <ul style="list-style-type: none">• I>> . Definition = Trip Signal: Trip due to a fault in phase L2	
I>> . Trip IL3	[Operation / Status Display / I>>]
 Only available if: <ul style="list-style-type: none">• I>> . Definition = Trip Signal: Trip due to a fault in phase L3	
I>> . Alarm IL1	[Operation / Status Display / I>>]
 Only available if: <ul style="list-style-type: none">• I>> . Definition = Alarm Signal: Alarm due to a fault in phase L1	
I>> . Alarm IL2	[Operation / Status Display / I>>]
 Only available if: <ul style="list-style-type: none">• I>> . Definition = Alarm Signal: Alarm due to a fault in phase L2	

I>> . Alarm IL3	[Operation / Status Display / I>>]
↑ Only available if: <ul style="list-style-type: none">• I>> . Definition = Alarm Signal: Alarm due to a fault in phase L3	
I>> . Pickup IL1	[Operation / Status Display / I>>]
↑ Signal: Pickup in phase L1	
I>> . Pickup IL2	[Operation / Status Display / I>>]
↑ Signal: Pickup in phase L2	
I>> . Pickup IL3	[Operation / Status Display / I>>]
↑ Signal: Pickup in phase L3	
I>> . IH2 Blo	[Operation / Status Display / I>>]
↑ Signal: Blocking the trip command by an inrush	


9.10 I>>> - Phase Overcurrent Stage


9.10.1 I>>>: Device Planning Parameters


I>>> . Mode	[Device planning / Projected Elements]	
“-” <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	“-”, use ↳ Device planning	P.1
 <i>Phase Overcurrent Stage, general operation mode</i>		

I>>> . Definition	[Device planning / Definition]	
Trip <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	Trip, Alarm ↳ Definition	P.1
 <i>Phase Overcurrent Stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>		

9.10.2 I>>>: Settings


I>>> . Function	[Protection Para / I>>>]	
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


I>>> . I	[Protection Para / I>>>]	
1.00In	If: I>>> . Char = DEFT • 0.35In ... 20.00In If: I>>> . Char = IEC NINV • 0.35In ... 2.50In If: I>>> . Char = IEC VINV • 0.35In ... 2.50In If: I>>> . Char = IEC EINV • 0.35In ... 2.50In If: I>>> . Char = IEC LINV • 0.35In ... 2.50In If: I>>> . Char = RINV • 0.35In ... 2.50In If: I>>> . Char = HV Fuse • 0.35In ... 2.50In If: I>>> . Char = FR Fuse • 0.35In ... 2.50In If: I>>> . Char = IEEE MINV • 0.35In ... 2.50In If: I>>> . Char = IEEE VINV • 0.35In ... 2.50In If: I>>> . Char = IEEE EINV • 0.35In ... 2.50In If: I>>> . Char = EF Curve • 0.35In ... 2.50In	P.1
	<p>If the pickup value is exceeded, the protection stage starts to time out to trip.</p> <p>WARNING: Check the Technical Data and ensure that the actual overcurrent settings for this pickup threshold and the trip delay comply with the technical limits of the phase current inputs! (The device allows for overcurrent settings that are out of the permitted range of current values.)</p>	


I>>> . Char	[Protection Para / I>>>]	
DEFT	DEFT ... EF Curve ↳ Char	P.1
	Characteristic	

9 Protection Parameter


9.10.2 I>>>: Settings


I>>> . t	[Protection Para / I>>>]	
0.1s <i>Only available if:</i> • I>>> . Char = DEFT	0.00s ... 300.00s	P.1
 <i>Time delay for trip or alarm</i>		


I>>> . tChar	[Protection Para / I>>>]	
0.1 <i>Only available if:</i> • I>>> . Char = IEC NINV • I>>> . Char = IEC VINV • I>>> . Char = IEC EINV • I>>> . Char = IEC LINV • I>>> . Char = RINV • I>>> . Char = HV Fuse • I>>> . Char = FR Fuse • I>>> . Char = IEEE MINV • I>>> . Char = IEEE VINV • I>>> . Char = IEEE EINV • I>>> . Char = EF Curve	0.05 ... 10.00	P.1
 <i>Time multiplier/tripping characteristic factor. The setting range depends on the selected tripping curve.</i>		


I>>> . tMin	[Protection Para / I>>>]	
0.00s <i>Only available if:</i> • I>>> . Char = IEC NINV • I>>> . Char = IEC VINV • I>>> . Char = IEC EINV • I>>> . Char = IEC LINV • I>>> . Char = RINV • I>>> . Char = HV Fuse • I>>> . Char = FR Fuse • I>>> . Char = IEEE MINV • I>>> . Char = IEEE VINV • I>>> . Char = IEEE EINV • I>>> . Char = EF Curve	0.00s ... 20.00s	P.1
 <i>Minimum trip delay time. Independent of the measured current values, the trip delay time does never fall below the minimum that is set here.</i>		

I>>> . Reset Mode	[Protection Para / I>>>]	
instantaneous	If: I>>> . Char = DEFT <ul style="list-style-type: none"> instantaneous, definite time If: I>>> . Char = IEC NINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = IEC VINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = IEC EINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = IEC LINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = RINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = HV Fuse <ul style="list-style-type: none"> instantaneous, definite time If: I>>> . Char = FR Fuse <ul style="list-style-type: none"> instantaneous, definite time If: I>>> . Char = IEEE MINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = IEEE VINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = IEEE EINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I>>> . Char = EF Curve <ul style="list-style-type: none"> instantaneous, definite time ↪ Reset Mode	P.1
	<i>Reset Mode</i>	


I>>> . tReset	[Protection Para / I>>>]	
0.1s <i>Only available if:</i> <ul style="list-style-type: none">I>>> . Reset Mode = definite time	0.00s ... 60.00s	P.1
	<i>Reset delay for intermittent phase failures (INV characteristics only)</i>	

I>>> . IH2 Blo	[Protection Para / I>>>]	
Active	If: IH2 . Mode = use • Inactive, Active If: IH2 . Mode = “-” • Inactive Mode	P.1
	Blocking the trip command, if an inrush is detected.	


I>>> . Stab. by CLPU	[Protection Para / I>>>]	
Inactive	Inactive, Active Mode	P.1
Only available if:	• CLPU . Mode = use	
	Select whether the CLPU stabilization shall be effective for this protection stage. (If set to “active” then further settings are available within the CLPU menu.)	


I>>> . ExBlo	[Protection Para / I>>>]	
“-”	“-” ... Prot . Pos OFF Mode	P.1
	External blocking of the module if the state of the assigned signal is true.	

9.10.3 I>>>: Input States

I>>> . ExBlo-I	[Operation / Status Display / I>>>]	
	Module input state: External blocking	

9.10.4 I>>>: Signals (Output States)

I>>> . Active	[Operation / Status Display / All Actives] [Operation / Status Display / I>>>]	
	Signal: active	

I>>> . Trip	[Operation / Status Display / Trips] [Operation / Status Display / I>>>]	
	Only available if: • I>>> . Definition = Trip Signal: Trip	

I>>> . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / I>>>]
---------------------	--

<p>↑ Only available if:</p> <ul style="list-style-type: none"> • I>>> . Definition = Alarm <p>Signal: Alarm</p>

I>>> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / I>>>]
----------------------	---

<p>↑ Signal: Pickup</p>

I>>> . Trip IL1	[Operation / Status Display / I>>>]
------------------------	-------------------------------------

<p>↑ Only available if:</p> <ul style="list-style-type: none"> • I>>> . Definition = Trip <p>Signal: Trip due to a fault in phase L1</p>
--

I>>> . Trip IL2	[Operation / Status Display / I>>>]
------------------------	-------------------------------------

<p>↑ Only available if:</p> <ul style="list-style-type: none"> • I>>> . Definition = Trip <p>Signal: Trip due to a fault in phase L2</p>
--

I>>> . Trip IL3	[Operation / Status Display / I>>>]
------------------------	-------------------------------------

<p>↑ Only available if:</p> <ul style="list-style-type: none"> • I>>> . Definition = Trip <p>Signal: Trip due to a fault in phase L3</p>
--

I>>> . Alarm IL1	[Operation / Status Display / I>>>]
-------------------------	-------------------------------------

<p>↑ Only available if:</p> <ul style="list-style-type: none"> • I>>> . Definition = Alarm <p>Signal: Alarm due to a fault in phase L1</p>
--

I>>> . Alarm IL2	[Operation / Status Display / I>>>]
-------------------------	-------------------------------------

<p>↑ Only available if:</p> <ul style="list-style-type: none"> • I>>> . Definition = Alarm <p>Signal: Alarm due to a fault in phase L2</p>
--


9 Protection Parameter


9.10.4 I>>>: Signals (Output States)

I>>> . Alarm IL3	[Operation / Status Display / I>>>]
↑ Only available if: <ul style="list-style-type: none">• I>>> . Definition = Alarm Signal: Alarm due to a fault in phase L3	
I>>> . Pickup IL1	[Operation / Status Display / I>>>]
↑ Signal: Pickup in phase L1	
I>>> . Pickup IL2	[Operation / Status Display / I>>>]
↑ Signal: Pickup in phase L2	
I>>> . Pickup IL3	[Operation / Status Display / I>>>]
↑ Signal: Pickup in phase L3	
I>>> . IH2 Blo	[Operation / Status Display / I>>>]
↑ Signal: Blocking the trip command by an inrush	


9.11 IG> - Ground (earth) current protection stage

9.11.1 IG>: Device Planning Parameters

IG> . Mode		[Device planning / Projected Elements]
use	“-”, use ↳ Device planning	P.1
	<i>Earth current protection stage, general operation mode</i>	


IG> . Definition		[Device planning / Definition]
Trip	Trip, Alarm ↳ Definition	P.1
	<i>Earth current protection stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>	


9.11.2 IG>: Settings

IG> . Function		[Protection Para / IG>]
Active	Inactive, Active ↳ Mode	P.1
	<i>Permanent activation or deactivation of module/stage.</i>	

IG> . IG	[Protection Para / IG>]	
1.00In	If: CT . IG Source = calculated AND IG> . Char = DEFT • 0.20In ... 10.00In If: CT . IG Source = calculated AND IG> . Char = IEC NINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = IEC VINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = IEC EINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = IEC LINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = RINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = HV Fuse • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = FR Fuse • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = IEEE MINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = IEEE VINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = IEEE EINV • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = EF Curve • 0.20In ... 2.50In If: CT . IG Source = calculated AND IG> . Char = RXIDG • 0.20In ... 2.50In If: CT . IG Source = measured AND IG> . Char = DEFT • 0.02In ... 10.00In If: CT . IG Source = measured AND IG> . Char = IEC NINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = IEC VINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = IEC EINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = IEC LINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = RINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = HV Fuse • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = FR Fuse • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = IEEE MINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = IEEE VINV • 0.02In ... 2.50In If: CT . IG Source = measured AND IG> . Char = IEEE EINV • 0.02In ... 2.50In	P.1


IG> . Char		[Protection Para / IG>]
DEFT	DEFT ... RXIDG	P.1
		↳ Char
	Characteristic	

IG> . t		[Protection Para / IG>]
0.1s	0.00s ... 300.00s	P.1
Only available if:		
<ul style="list-style-type: none"> IG> . Char = DEFT 		
	Time delay for trip or alarm	


IG> . tChar		[Protection Para / IG>]
0.1	0.05 ... 10.00	P.1
Only available if:		
<ul style="list-style-type: none"> IG> . Char = IEC NINV IG> . Char = IEC VINV IG> . Char = IEC EINV IG> . Char = IEC LINV IG> . Char = RINV IG> . Char = HV Fuse IG> . Char = FR Fuse IG> . Char = IEEE MINV IG> . Char = IEEE VINV IG> . Char = IEEE EINV IG> . Char = EF Curve IG> . Char = RXIDG 		
	Time multiplier/tripping characteristic factor. The setting range depends on the selected tripping curve.	

9 Protection Parameter


9.11.2 IG>: Settings

IG> . tMin	[Protection Para / IG>]	
<p>0.00s</p> <p><i>Only available if:</i></p> <ul style="list-style-type: none">• IG> . Char = IEC NINV• IG> . Char = IEC VINV• IG> . Char = IEC EINV• IG> . Char = IEC LINV• IG> . Char = RINV• IG> . Char = HV Fuse• IG> . Char = FR Fuse• IG> . Char = IEEE MINV• IG> . Char = IEEE VINV• IG> . Char = IEEE EINV• IG> . Char = EF Curve• IG> . Char = RXIDG	0.00s ... 20.00s	P.1
	<p><i>Minimum trip delay time. Independent of the measured current values, the trip delay time does never fall below the minimum that is set here.</i></p>	

IG> . Reset Mode	[Protection Para / IG>]	
instantaneous	<p>If: IG> . Char = DEFT</p> <ul style="list-style-type: none"> instantaneous, definite time <p>If: IG> . Char = IEC NINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = IEC VINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = IEC EINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = IEC LINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = RINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = HV Fuse</p> <ul style="list-style-type: none"> instantaneous, definite time <p>If: IG> . Char = FR Fuse</p> <ul style="list-style-type: none"> instantaneous, definite time <p>If: IG> . Char = IEEE MINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = IEEE VINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = IEEE EINV</p> <ul style="list-style-type: none"> instantaneous, definite time, inverse time <p>If: IG> . Char = EF Curve</p> <ul style="list-style-type: none"> instantaneous, definite time <p>If: IG> . Char = RXIDG</p> <ul style="list-style-type: none"> instantaneous, definite time <p>↪ Reset Mode</p>	P.1

 *Reset Mode*

IG> . tReset	[Protection Para / IG>]	
0.1s <i>Only available if:</i>	0.00s ... 60.00s	P.1
<ul style="list-style-type: none"> IG> . Reset Mode = definite time 		

 *Reset delay for intermittent phase failures (INV characteristics only)*

IG> . IH2 Blo		[Protection Para / IG>]
	If: IH2 . Mode = use • Inactive, Active If: IH2 . Mode = “-” • Inactive Mode	P.1
	Blocking the trip command, if an inrush is detected.	

IG> . Stab. by CLPU		[Protection Para / IG>]
Inactive Only available if: • CLPU . Mode = use	Inactive, Active Mode	P.1
	Select whether the CLPU stabilization shall be effective for this protection stage. (If set to “active” then further settings are available within the CLPU menu.)	

IG> . ExBlo		[Protection Para / IG>]
“-”	“-” ... Prot . Pos OFF Mode	P.1
	External blocking of the module if the state of the assigned signal is true.	

9.11.3 IG>: Input States

IG> . ExBlo-I		[Operation / Status Display / IG>]
	Module input state: External blocking	

9.11.4 IG>: Signals (Output States)


IG> . Active		[Operation / Status Display / All Actives] [Operation / Status Display / IG>]
	Signal: active	


IG> . Trip		[Operation / Status Display / Trips] [Operation / Status Display / IG>]
	Only available if: • IG> . Definition = Trip Signal: Trip	

IG> . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / IG>]
↑ Only available if: <ul style="list-style-type: none">• IG> . Definition = Alarm Signal: Alarm	
IG> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / IG>]
↑ Signal: Pickup	
IG> . IH2 Blo	[Operation / Status Display / IG>]
↑ Signal: Blocking the trip command by an inrush	


9.12 IG>> - Ground (earth) current protection stage

9.12.1 IG>>: Device Planning Parameters

IG>> . Mode	[Device planning / Projected Elements]	
“-” <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	“-”, use ↳ Device planning	P.1
 <i>Earth current protection stage, general operation mode</i>		

IG>> . Definition	[Device planning / Definition]	
Trip <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	Trip, Alarm ↳ Definition	P.1
 <i>Earth current protection stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>		

9.12.2 IG>>: Settings


IG>> . Function	[Protection Para / IG>>]	
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


IG>> . IG	[Protection Para / IG>>]	
1.00In	<p>If: CT . IG Source = calculated AND IG>> . Char = DEFT</p> <ul style="list-style-type: none"> • 0.20In ... 10.00In <p>If: CT . IG Source = calculated AND IG>> . Char = IEC NINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = IEC VINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = IEC EINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = IEC LINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = RINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = HV Fuse</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = FR Fuse</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = IEEE MINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = IEEE VINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = IEEE EINV</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = EF Curve</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = calculated AND IG>> . Char = RXIDG</p> <ul style="list-style-type: none"> • 0.20In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = DEFT</p> <ul style="list-style-type: none"> • 0.02In ... 10.00In <p>If: CT . IG Source = measured AND IG>> . Char = IEC NINV</p> <ul style="list-style-type: none"> • 0.02In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = IEC VINV</p> <ul style="list-style-type: none"> • 0.02In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = IEC EINV</p> <ul style="list-style-type: none"> • 0.02In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = IEC LINV</p> <ul style="list-style-type: none"> • 0.02In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = RINV</p> <ul style="list-style-type: none"> • 0.02In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = HV Fuse</p> <ul style="list-style-type: none"> • 0.02In ... 2.50In <p>If: CT . IG Source = measured AND IG>> . Char = FR Fuse</p>	P.1


9 Protection Parameter


9.12.2 IG>>: Settings


IG>> . Char		[Protection Para / IG>>]
DEFT	DEFT ... RXIDG	P.1
		↳ Char
 <i>Characteristic</i>		

IG>> . t		[Protection Para / IG>>]
0.1s	0.00s ... 300.00s	P.1
<i>Only available if:</i>		
<ul style="list-style-type: none"> • IG>> . Char = DEFT 		
 <i>Time delay for trip or alarm</i>		

IG>> . tChar		[Protection Para / IG>>]
0.1	0.05 ... 10.00	P.1
<i>Only available if:</i>		
<ul style="list-style-type: none"> • IG>> . Char = IEC NINV • IG>> . Char = IEC VINV • IG>> . Char = IEC EINV • IG>> . Char = IEC LINV • IG>> . Char = RINV • IG>> . Char = HV Fuse • IG>> . Char = FR Fuse • IG>> . Char = IEEE MINV • IG>> . Char = IEEE VINV • IG>> . Char = IEEE EINV • IG>> . Char = EF Curve • IG>> . Char = RXIDG 		
 <i>Time multiplier/tripping characteristic factor. The setting range depends on the selected tripping curve.</i>		

IG>> . tMin	[Protection Para / IG>>]	
0.00s <i>Only available if:</i> <ul style="list-style-type: none"> • IG>> . Char = IEC NINV • IG>> . Char = IEC VINV • IG>> . Char = IEC EINV • IG>> . Char = IEC LINV • IG>> . Char = RINV • IG>> . Char = HV Fuse • IG>> . Char = FR Fuse • IG>> . Char = IEEE MINV • IG>> . Char = IEEE VINV • IG>> . Char = IEEE EINV • IG>> . Char = EF Curve • IG>> . Char = RXIDG 	0.00s ... 20.00s	P.1
 <i>Minimum trip delay time. Independent of the measured current values, the trip delay time does never fall below the minimum that is set here.</i>		

IG>> . Reset Mode	[Protection Para / IG>>]	
instantaneous	If: IG>> . Char = DEFT • instantaneous, definite time If: IG>> . Char = IEC NINV • instantaneous, definite time, inverse time If: IG>> . Char = IEC VINV • instantaneous, definite time, inverse time If: IG>> . Char = IEC EINV • instantaneous, definite time, inverse time If: IG>> . Char = IEC LINV • instantaneous, definite time, inverse time If: IG>> . Char = RINV • instantaneous, definite time, inverse time If: IG>> . Char = HV Fuse • instantaneous, definite time If: IG>> . Char = FR Fuse • instantaneous, definite time If: IG>> . Char = IEEE MINV • instantaneous, definite time, inverse time If: IG>> . Char = IEEE VINV • instantaneous, definite time, inverse time If: IG>> . Char = IEEE EINV • instantaneous, definite time, inverse time If: IG>> . Char = EF Curve • instantaneous, definite time If: IG>> . Char = RXIDG • instantaneous, definite time ↪ Reset Mode	P.1
	<i>Reset Mode</i>	

IG>> . tReset	[Protection Para / IG>>]	
0.1s <i>Only available if:</i> • IG>> . Reset Mode = definite time	0.00s ... 60.00s	P.1
	<i>Reset delay for intermittent phase failures (INV characteristics only)</i>	

IG>> . IH2 Blo		[Protection Para / IG>>]
	If: IH2 . Mode = use <ul style="list-style-type: none"> • Inactive, Active If: IH2 . Mode = “-” <ul style="list-style-type: none"> • Inactive Mode	P.1
	Blocking the trip command, if an inrush is detected.	

IG>> . Stab. by CLPU		[Protection Para / IG>>]
Inactive	Inactive, Active	P.1
Only available if:	Mode	
	<ul style="list-style-type: none"> • CLPU . Mode = use 	
	Select whether the CLPU stabilization shall be effective for this protection stage. (If set to “active” then further settings are available within the CLPU menu.)	

IG>> . ExBlo		[Protection Para / IG>>]
“-”	“-” ... Prot . Pos OFF	P.1
	Mode	
	External blocking of the module if the state of the assigned signal is true.	

9.12.3 IG>>: Input States

IG>> . ExBlo-I		[Operation / Status Display / IG>>]
	Module input state: External blocking	

9.12.4 IG>>: Signals (Output States)

IG>> . Active		[Operation / Status Display / All Actives]
		[Operation / Status Display / IG>>]
	Signal: active	

IG>> . Trip		[Operation / Status Display / Trips]
		[Operation / Status Display / IG>>]
	Only available if:	
	<ul style="list-style-type: none"> • IG>> . Definition = Trip 	
	Signal: Trip	


9 Protection Parameter


9.12.4 IG>>: Signals (Output States)

IG>> . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / IG>>]
↑ Only available if: <ul style="list-style-type: none">• IG>> . Definition = Alarm Signal: Alarm	
IG>> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / IG>>]
↑ Signal: Pickup	
IG>> . IH2 Blo	[Operation / Status Display / IG>>]
↑ Signal: Blocking the trip command by an inrush	


9.13 I2/I1> - Unbalanced Load Protection


9.13.1 I2/I1>: Device Planning Parameters

I2/I1> . Mode	[Device planning / Projected Elements]	
“-” <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	“-”, use ↳ Device planning	P.1
 <i>Unbalanced Load-Stage, general operation mode</i>		


I2/I1> . Definition	[Device planning / Definition]	
Trip <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	Trip, Alarm ↳ Definition	P.1
 <i>Unbalanced Load-Stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>		


9.13.2 I2/I1>: Settings

I2/I1> . Function	[Protection Para / I2/I1>]	
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


I2/I1> . I2/I1	[Protection Para / I2/I1>]	
20%	10% ... 40%	P.1
 <i>I2/I1 unbalance trip pickup setting (in percent), i.e. the ratio of negative sequence current I2 to the positive sequence current I1.</i>		

I2/I1> . t	[Protection Para / I2/I1>]	
0.1s	0.00s ... 300.00s	P.1
 <i>Time delay for trip or alarm</i>		


I2/I1> . IH2 Blo	[Protection Para / I2/I1>]	
Active	If: IH2 . Mode = use <ul style="list-style-type: none"> • Inactive, Active If: IH2 . Mode = "-" <ul style="list-style-type: none"> • Inactive Mode	P.1
	Blocking the trip command, if an inrush is detected.	


I2/I1> . ExBlo	[Protection Para / I2/I1>]	
"-"	"-" ... Prot . Pos OFF Mode	P.1
	External blocking of the module if the state of the assigned signal is true.	


9.13.3 I2/I1>: Input States



I2/I1> . ExBlo-I	[Operation / Status Display / I2/I1>]	
	Module input state: External blocking	

9.13.4 I2/I1>: Signals (Output States)

I2/I1> . Active	[Operation / Status Display / All Actives]	
	[Operation / Status Display / I2/I1>]	
	Signal: active	


I2/I1> . Trip	[Operation / Status Display / Trips]	
	[Operation / Status Display / I2/I1>]	
	Only available if: <ul style="list-style-type: none"> • I2/I1> . Definition = Trip Signal: Trip	


I2/I1> . Alarm	[Operation / Status Display / Alarms]	
	[Operation / Status Display / I2/I1>]	
	Only available if: <ul style="list-style-type: none"> • I2/I1> . Definition = Alarm Signal: Alarm	

I2/I1> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / I2/I1>]
 <i>Signal: Pickup</i>	
I2/I1> . IH2 Blo	[Operation / Status Display / I2/I1>]
 <i>Signal: Blocking the trip command by an inrush</i>	


9.14 I2> - Negative-Sequence Current Protection


9.14.1 I2>: Device Planning Parameters


I2> . Mode		[Device planning / Projected Elements]
“-”	“-”, use	P.1
Only available if:	↳ Device planning	
• Prot . Settings valid = Software		
	Unbalanced Load-Stage, general operation mode	


I2> . Definition		[Device planning / Definition]
Trip	Trip, Alarm	P.1
Only available if:	↳ Definition	
• Prot . Settings valid = Software		
	Unbalanced Load-Stage: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.	


9.14.2 I2>: Settings


I2> . Function		[Protection Para / I2>]
Active	Inactive, Active	P.1
	↳ Mode	
	Permanent activation or deactivation of module/stage.	


I2> . I2		[Protection Para / I2>]
0.2In	0.2In ... 2.5In	P.1
	The Threshold setting defines a minimum operating current magnitude of I2 for the 46 function to operate, which ensures that the relay has a solid basis for initiating a current unbalance trip. This is a supervisory function and not a trip level.	


I2> . Char		[Protection Para / I2>]
DEFT	DEFT ... EF Curve	P.1
	↳ Char	
	Characteristic	


I2> . t	[Protection Para / I2>]	
0.1s <i>Only available if:</i> • I2> . Char = DEFT	0.00s ... 300.00s	P.1
 Time delay for trip or alarm		


I2> . tChar	[Protection Para / I2>]	
0.1 <i>Only available if:</i> • I2> . Char = IEC NINV • I2> . Char = IEC VINV • I2> . Char = IEC EINV • I2> . Char = IEC LINV • I2> . Char = RINV • I2> . Char = HV Fuse • I2> . Char = FR Fuse • I2> . Char = IEEE MINV • I2> . Char = IEEE VINV • I2> . Char = IEEE EINV • I2> . Char = EF Curve	0.05 ... 10.00	P.1
 Time multiplier/tripping characteristic factor. The setting range depends on the selected tripping curve.		

I2> . tMin	[Protection Para / I2>]	
0.00s <i>Only available if:</i> • I2> . Char = IEC NINV • I2> . Char = IEC VINV • I2> . Char = IEC EINV • I2> . Char = IEC LINV • I2> . Char = RINV • I2> . Char = HV Fuse • I2> . Char = FR Fuse • I2> . Char = IEEE MINV • I2> . Char = IEEE VINV • I2> . Char = IEEE EINV • I2> . Char = EF Curve	0.00s ... 20.00s	P.1
 Minimum trip delay time. Independent of the measured current values, the trip delay time does never fall below the minimum that is set here.		


I2> . Reset Mode	[Protection Para / I2>]	
instantaneous	If: I2> . Char = DEFT <ul style="list-style-type: none"> instantaneous, definite time If: I2> . Char = IEC NINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = IEC VINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = IEC EINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = IEC LINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = RINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = HV Fuse <ul style="list-style-type: none"> instantaneous, definite time If: I2> . Char = FR Fuse <ul style="list-style-type: none"> instantaneous, definite time If: I2> . Char = IEEE MINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = IEEE VINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = IEEE EINV <ul style="list-style-type: none"> instantaneous, definite time, inverse time If: I2> . Char = EF Curve <ul style="list-style-type: none"> instantaneous, definite time ↪ Reset Mode	P.1
 <i>Reset Mode</i>		

I2> . tReset	[Protection Para / I2>]	
0.1s <i>Only available if:</i> <ul style="list-style-type: none"> I2> . Reset Mode = definite time 	0.00s ... 60.00s	P.1
 <i>Reset delay for intermittent phase failures (INV characteristics only)</i>		


I2> . IH2 Blo	[Protection Para / I2>]	
Active	If: IH2 . Mode = use <ul style="list-style-type: none"> • Inactive, Active If: IH2 . Mode = "-" <ul style="list-style-type: none"> • Inactive Mode	P.1
	<i>Blocking the trip command, if an inrush is detected.</i>	


I2> . ExBlo	[Protection Para / I2>]	
"-"	"-" ... Prot . Pos OFF Mode	P.1
	<i>External blocking of the module if the state of the assigned signal is true.</i>	


9.14.3 I2>: Input States

I2> . ExBlo-I	[Operation / Status Display / I2>]	
	<i>Module input state: External blocking</i>	

9.14.4 I2>: Signals (Output States)

I2> . Active	[Operation / Status Display / All Actives]	
	[Operation / Status Display / I2>]	
	<i>Signal: active</i>	

I2> . Trip	[Operation / Status Display / Trips]	
	[Operation / Status Display / I2>]	
	<i>Only available if:</i> <ul style="list-style-type: none"> • I2> . Definition = Trip <i>Signal: Trip</i>	

I2> . Alarm	[Operation / Status Display / Alarms]	
	[Operation / Status Display / I2>]	
	<i>Only available if:</i> <ul style="list-style-type: none"> • I2> . Definition = Alarm <i>Signal: Alarm</i>	


9 Protection Parameter


9.14.4 I2>: Signals (Output States)

I2> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / I2>]
⬆️	Signal: Pickup
I2> . IH2 Blo	[Operation / Status Display / I2>]
⬆️	Signal: Blocking the trip command by an inrush


9.15 ThR - Thermal replica module

9.15.1 ThR: Device Planning Parameters


ThR . Mode	[Device planning / Projected Elements]	
“-” <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	“-”, use ↳ Device planning	P.1
 <i>Thermal replica module, general operation mode</i>		


ThR . Definition	[Device planning / Definition]	
Trip <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	Trip, Alarm ↳ Definition	P.1
 <i>Thermal replica module: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>		


9.15.2 ThR: Settings

ThR . Function	[Protection Para / ThR]	
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


ThR . Ib	[Protection Para / ThR]	
1.00In	0.5In ... 2.00In	P.1
 <i>Base current: Maximum permissible thermal continuous current.</i>		


ThR . K	[Protection Para / ThR]	
1.00	0.80 ... 1.50	P.1
 <i>Overload Factor: The maximum thermal limit is defined as $k \cdot I_B$, the product of the overload factor and the base current.</i>		

ThR . Pre-Alarm Lev.	[Protection Para / ThR]	
80%	50% ... 100%	P.1
 <i>Threshold value for the Thermal Level. If the thermal level exceeds this setting the signal »ThR . Pre-Alarm« is issued.</i>		


ThR . τ-warm	[Protection Para / ThR]	
300s	10s ... 30000s	P.1
 Warming-up time constant		

ThR . τ-cool	[Protection Para / ThR]	
300s	10s ... 30000s	P.1
 Cooling time constant		


ThR . Initial Thermal Level	[Protection Para / ThR]	
Zero	Zero, Last Stored Value ↳ Initial Thermal Level	P.1
 Select the criterion for setting the initial thermal level after a restart of the device.		

ThR . ExBlo	[Protection Para / ThR]	
"_"	"-" ... Prot . Pos OFF ↳	P.1
 External blocking of the module if the state of the assigned signal is true.		


9.15.3 ThR: Direct Controls

ThR . Rst. Thermal Lev.	[Operation / Reset]	
Inactive	Inactive, Active ↳ Mode	P.1
 Reset the thermal level		

9.15.4 ThR: Input States

ThR . ExBlo-I	[Operation / Status Display / ThR]	
 Module input state: External blocking		

9.15.5 ThR: Signals (Output States)

ThR . Active	[Operation / Status Display / All Actives] [Operation / Status Display / ThR]	
 Signal: active		


ThR . Trip		[Operation / Status Display / Trips] [Operation / Status Display / ThR]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • ThR . Definition = Trip <i>Signal: Trip</i>	
ThR . Alarm		[Operation / Status Display / Alarms] [Operation / Status Display / ThR]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • ThR . Definition = Alarm <i>Signal: Alarm</i>	
ThR . Pickup		[Operation / Status Display / Pickups] [Operation / Status Display / ThR]
↑	<i>Signal: Pickup</i>	
ThR . Pre-Alarm		[Operation / Status Display / ThR]
↑	<i>Signal: The set value for the θ Threshold has been exceeded.</i>	


9.15.6 ThR: Values

ThR . Therm. Lev.		[Operation / Measured Values / ThR]
✎	<i>Measured value: Ongoing thermal level</i>	


9.16 Ipeak> - Peak-Value Overcurrent


9.16.1 Ipeak>: Device Planning Parameters


Ipeak> . Mode		[Device planning / Projected Elements]
use	"-", use	P.1
	↳ Device planning	
	<i>Peak-Value Overcurrent, general operation mode</i>	


Ipeak> . Definition		[Device planning / Definition]
Trip	Trip, Alarm	P.1
	↳ Definition	
	<i>Peak-Value Overcurrent: If set to "Alarm": The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to "Trip": The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>	

9.16.2 Ipeak>: Settings

Ipeak> . Function		[Protection Para / Ipeak>]
Active	Inactive, Active	P.1
	↳ Mode	
	<i>Permanent activation or deactivation of module/stage.</i>	

Ipeak> . I		[Protection Para / Ipeak>]
8.0In	4.0In ... 20.00In	P.1
	<i>Pickup threshold, defined as RMS value (i.e. peak current value divided by $\sqrt{2}$). If the pickup value is exceeded, the module/element starts to time out to trip.</i>	

Ipeak> . t		[Protection Para / Ipeak>]
0.0s	0.00s ... 5.00s	P.1
	<i>Time delay for trip or alarm</i>	

Ipeak> . ExBlo		[Protection Para / Ipeak>]
"_"	"_" ... Prot . Pos OFF	P.1
	↳	
	<i>External blocking of the module if the state of the assigned signal is true.</i>	

9.16.3 Ipeak>: Input States

Ipeak> . ExBlo-I	[Operation / Status Display / Ipeak>]
↓	Module input state: External blocking

9.16.4 Ipeak>: Signals (Output States)

Ipeak> . Active	[Operation / Status Display / All Actives] [Operation / Status Display / Ipeak>]
↑	Signal: active

Ipeak> . Trip	[Operation / Status Display / Trips] [Operation / Status Display / Ipeak>]
↑	Only available if: <ul style="list-style-type: none"> Ipeak> . Definition = Trip Signal: Trip

Ipeak> . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / Ipeak>]
↑	Only available if: <ul style="list-style-type: none"> Ipeak> . Definition = Alarm Signal: Alarm

Ipeak> . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / Ipeak>]
↑	Signal: Pickup

Ipeak> . Trip IL1	[Operation / Status Display / Ipeak>]
↑	Only available if: <ul style="list-style-type: none"> Ipeak> . Definition = Trip Signal: Trip due to a fault in phase L1

Ipeak> . Trip IL2	[Operation / Status Display / Ipeak>]
↑	Only available if: <ul style="list-style-type: none"> Ipeak> . Definition = Trip Signal: Trip due to a fault in phase L2


9 Protection Parameter


9.16.4 Ipeak>: Signals (Output States)

Ipeak> . Trip IL3		[Operation / Status Display / Ipeak>]
↑	<i>Only available if:</i> <ul style="list-style-type: none">• Ipeak> . Definition = Trip <i>Signal: Trip due to a fault in phase L3</i>	
Ipeak> . Alarm IL1		[Operation / Status Display / Ipeak>]
↑	<i>Only available if:</i> <ul style="list-style-type: none">• Ipeak> . Definition = Alarm <i>Signal: Alarm due to a fault in phase L1</i>	
Ipeak> . Alarm IL2		[Operation / Status Display / Ipeak>]
↑	<i>Only available if:</i> <ul style="list-style-type: none">• Ipeak> . Definition = Alarm <i>Signal: Alarm due to a fault in phase L2</i>	
Ipeak> . Alarm IL3		[Operation / Status Display / Ipeak>]
↑	<i>Only available if:</i> <ul style="list-style-type: none">• Ipeak> . Definition = Alarm <i>Signal: Alarm due to a fault in phase L3</i>	
Ipeak> . Pickup IL1		[Operation / Status Display / Ipeak>]
↑	<i>Signal: Pickup in phase L1</i>	
Ipeak> . Pickup IL2		[Operation / Status Display / Ipeak>]
↑	<i>Signal: Pickup in phase L2</i>	
Ipeak> . Pickup IL3		[Operation / Status Display / Ipeak>]
↑	<i>Signal: Pickup in phase L3</i>	


9.17 SOTF - Switch Onto Fault - Module


9.17.1 SOTF: Device Planning Parameters


SOTF . Mode		[Device planning / Projected Elements]
use	"-", use ↳ Device planning	P.1
	<i>Switch Onto Fault - Module, general operation mode</i>	


SOTF . Definition		[Device planning / Definition]
Trip	Trip, Alarm ↳ Definition	P.1
	<i>Switch Onto Fault - Module: If set to "Alarm": The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to "Trip": The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>	



9.17.2 SOTF: Settings



SOTF . Function		[Protection Para / SOTF]
Active	Inactive, Active ↳ Mode	P.1
	<i>Permanent activation or deactivation of module/stage.</i>	

SOTF . Enabling		[Protection Para / SOTF]
Breaker Pos.	Breaker Pos., Close Command ↳ Enabling	P.1
	<i>Select the criterion for determining a manual CLOSE of the breaker. (After this, the »SOTF« module gets enabled for a particular settable time.)</i>	


SOTF . t-enable		[Protection Para / SOTF]
0.2s	0.10s ... 10.00s	P.1
	<i>While this timer is running, and while the module is not blocked, the Switch Onto Fault Module is effective (SOTF is armed).</i>	


SOTF . t		[Protection Para / SOTF]
0.0s	0.00s ... 10.00s	P.1
	<i>Time delay for trip or alarm. (For the »SOTF« module, an instantaneous tripping is typical, i.e. the setting value 0 s.)</i>	

SOTF . Trigger		[Protection Para / SOTF]
Ipeak> . Pickup	“-”, I> . Pickup, I>> . Pickup, I>>> . Pickup, Ipeak> . Pickup, Prot . Pickup	P.1
		
	Assign the type of pickup signal that triggers the SOTF module. If the assigned pickup signal is issued, the SOTF module itself picks up.	


SOTF . ExBlo		[Protection Para / SOTF]
“-”	“-” ... Prot . Pos OFF	P.1
		
	External blocking of the module if the state of the assigned signal is true.	


9.17.3 SOTF: Input States


SOTF . ExBlo-I		[Operation / Status Display / SOTF]
	Module input state: External blocking	

SOTF . Trigger-I		[Operation / Status Display / SOTF]
	State of the module input: Assign the type of pickup signal that triggers the SOTF module. If the assigned pickup signal is issued, the SOTF module itself picks up.	

9.17.4 SOTF: Signals (Output States)

SOTF . Active		[Operation / Status Display / All Actives] [Operation / Status Display / SOTF]
	Signal: active	


SOTF . Trip		[Operation / Status Display / Trips] [Operation / Status Display / SOTF]
	Only available if: <ul style="list-style-type: none"> • SOTF . Definition = Trip Signal: Trip	


SOTF . Alarm		[Operation / Status Display / Alarms] [Operation / Status Display / SOTF]
	Only available if: <ul style="list-style-type: none"> • SOTF . Definition = Alarm Signal: Alarm	

SOTF . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / SOTF]
↑	<i>Signal: Pickup</i>


9.18 Exp[1] - External Protection - Module


9.18.1 Exp[1]: Device Planning Parameters

Exp[1] . Mode		[Device planning / Projected Elements]
use	“-”, use ↳ Device planning	P.1
 <i>External Protection - Module, general operation mode</i>		

Exp[1] . Definition		[Device planning / Definition]
Trip	Trip, Alarm ↳ Definition	P.1
 <i>External Protection - Module: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>		



9.18.2 Exp[1]: Settings

Exp[1] . Function		[Protection Para / Exp[1]]
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		

Exp[1] . t		[Protection Para / Exp[1]]
0.00s	0.00s ... 60.00s	P.1
 <i>Time delay for trip or alarm</i>		

Exp[1] . Trigger Signal		[Protection Para / Exp[1]]
	If: Device Variant/Inputs = Without Inputs <ul style="list-style-type: none"> • “-” • “-” • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-” If: Device Variant/Inputs = Without Inputs <ul style="list-style-type: none"> • “-” • “-”, Prot . DI 1, Prot . DI 2 	P.1

Exp[1] . Trigger Signal	[Protection Para / Exp[1]]
	<ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 <p>If: Device Variant/Inputs = Ext. Trip</p> <ul style="list-style-type: none"> • Prot . DI 2 • Prot . DI 2 • Prot . DI 2 • Prot . DI 2 • Prot . DI 2 <p>If: Device Variant/Inputs = Ext. Trip, Ext. Reset</p> <ul style="list-style-type: none"> • Prot . DI 2 • Prot . DI 2 • Prot . DI 2 • “-” • “-” • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 <p>If: Device Variant/Inputs = Configurable</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-” • “-” • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 • “-”, Prot . DI 1, Prot . DI 2 <p>If: Device Variant/Inputs = Configurable Inputs</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 <p style="text-align: right;"></p>
	<i>Assign the trigger signal that will make the »Exp« module start (pickup).</i>

Exp[1] . ExBlo	[Protection Para / Exp[1]]
“-”	“-” ... Prot . Pos OFF <p style="text-align: right;"></p>
	<i>External blocking of the module if the state of the assigned signal is true.</i>

9.18.3 ExP[1]: Input States


ExP[1] . ExBlo-I	[Operation / Status Display / ExP[1]]
↓	<i>Module input state: External blocking</i>
ExP[1] . Trigger Signal-I	[Operation / Status Display / ExP[1]]
↓	<i>State of the module input: External trigger signal</i>


9.18.4 ExP[1]: Signals (Output States)

ExP[1] . Active	[Operation / Status Display / All Actives] [Operation / Status Display / ExP[1]]
↑	<i>Signal: active</i>
ExP[1] . Trip	[Operation / Status Display / Trips] [Operation / Status Display / ExP[1]]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • ExP[1] . Definition = Trip <i>Signal: Trip</i>
ExP[1] . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / ExP[1]]
↑	<i>Only available if:</i> <ul style="list-style-type: none"> • ExP[1] . Definition = Alarm <i>Alarm</i>
ExP[1] . Pickup	[Operation / Status Display / Pickups] [Operation / Status Display / ExP[1]]
↑	<i>Signal: Pickup</i>


9.19 ExP[2] - External Protection - Module


9.19.1 ExP[2]: Device Planning Parameters

ExP[2] . Mode	[Device planning / Projected Elements]	
use	“-”, use ↳ Device planning	P.1
	<i>External Protection - Module, general operation mode</i>	



ExP[2] . Definition	[Device planning / Definition]	
Trip	Trip, Alarm ↳ Definition	P.1
	<i>External Protection - Module: If set to “Alarm”: The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to “Trip”: The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>	


9.19.2 ExP[2]: Settings


ExP[2] . Function	[Protection Para / ExP[2]]	
Active	Inactive, Active ↳ Mode	P.1
	<i>Permanent activation or deactivation of module/stage.</i>	

ExP[2] . t	[Protection Para / ExP[2]]	
0.00s	0.00s ... 60.00s	P.1
	<i>Time delay for trip or alarm</i>	


ExP[2] . Trigger Signal	[Protection Para / ExP[2]]	
	If: Device Variant/Inputs = Without Inputs <ul style="list-style-type: none"> • “-” • “-” • “-” • “-” • “-” • “-”, Prot . DI 1, Prot . DI 2 • “-” If: Device Variant/Inputs = Without Inputs <ul style="list-style-type: none"> • “-” • “-” 	P.1


ExP[2] . Trigger Signal	[Protection Para / ExP[2]]
	<ul style="list-style-type: none"> • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip</p> <ul style="list-style-type: none"> • “_” • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” <p>If: Device Variant/Inputs = Ext. Trip, Ext. Reset</p> <ul style="list-style-type: none"> • “_” • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “_” <p>If: Device Variant/Inputs = Configurable</p> <ul style="list-style-type: none"> • “_” • “-”, Prot . DI 1, Prot . DI 2 • “_” • “_” • “_” • “_” • “_” <p>If: Device Variant/Inputs = Configurable Inputs</p> <ul style="list-style-type: none"> • “-”, Prot . DI 1, Prot . DI 2 <p></p>
	<p>Assign the trigger signal that will make the »ExP« module start (pickup).</p>


ExP[2] . Condition		[Protection Para / ExP[2]]
“-”	“-”, l> . Pickup, l>> . Pickup, l>>> . Pickup, lpeak> . Pickup, Prot . Pickup	P.1
	Assign a signal that must be active in addition to the external signal for making the »ExP« module start (pickup). (If no signal has been assigned here then the »ExP« module always picks up as soon as the external signal becomes active.)	

ExP[2] . ExBlo		[Protection Para / ExP[2]]
“-”	“-” ... Prot . Pos OFF	P.1
	External blocking of the module if the state of the assigned signal is true.	


9.19.3 ExP[2]: Input States


ExP[2] . ExBlo-I		[Operation / Status Display / ExP[2]]
	Module input state: External blocking	

ExP[2] . Trigger Signal-I		[Operation / Status Display / ExP[2]]
	State of the module input: External trigger signal	

ExP[2] . Condition-I		[Operation / Status Display / ExP[2]]
	State of the module input: Condition for External Protection	

9.19.4 ExP[2]: Signals (Output States)

ExP[2] . Active		[Operation / Status Display / All Actives] [Operation / Status Display / ExP[2]]
	Signal: active	

ExP[2] . Trip		[Operation / Status Display / Trips] [Operation / Status Display / ExP[2]]
	Only available if: <ul style="list-style-type: none"> • ExP[2] . Definition = Trip Signal: Trip	


9 Protection Parameter

9.19.4 ExP[2]: Signals (Output States)


ExP[2] . Alarm		[Operation / Status Display / Alarms]
		[Operation / Status Display / ExP[2]]
↑	<i>Only available if:</i> <ul style="list-style-type: none">• ExP[2] . Definition = Alarm <i>Alarm</i>	
ExP[2] . Pickup		[Operation / Status Display / Pickups]
		[Operation / Status Display / ExP[2]]
↑	<i>Signal: Pickup</i>	


9.20 CBF - Circuit breaker failure protection module


9.20.1 CBF: Device Planning Parameters

CBF . Mode	[Device planning / Projected Elements]	
“-” Only available if: • Prot . Settings valid = Software	“-”, use ↳ Device planning	P.1
 <i>Module Circuit Breaker Failure protection, general operation mode</i>		


9.20.2 CBF: Settings

CBF . Function	[Protection Para / CBF]	
Active	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


CBF . t-CBF	[Protection Para / CBF]	
0.20s	0.00s ... 1.00s	P.1
 <i>If the delay time is expired, a CBF alarm is issued.</i>		

CBF . ExBlo	[Protection Para / CBF]	
“-”	“-” ... Prot . Pos OFF ↳	P.1
 <i>External blocking of the module if the state of the assigned signal is true.</i>		

9.20.3 CBF: Input States

CBF . ExBlo-I	[Operation / Status Display / CBF]	
 <i>Module input state: External blocking</i>		

9.20.4 CBF: Signals (Output States)

CBF . Active	[Operation / Status Display / All Actives] [Operation / Status Display / CBF]	
 <i>Signal: active</i>		


9 Protection Parameter

9.20.4 CBF: Signals (Output States)


CBF . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / CBF]
↑	<i>Signal: Alarm</i>


9.21 CLPU – Cold Load Pickup Module


9.21.1 CLPU: Device Planning Parameters


CLPU . Mode	[Device planning / Projected Elements]	
“-” <i>Only available if:</i> <ul style="list-style-type: none"> Prot . Settings valid = Software 	“-”, use ↳ Device planning	P.1
 <i>Cold Load Pickup Module, general operation mode</i>		


9.21.2 CLPU: Settings


CLPU . Function	[Protection Para / CLPU]	
Inactive	Inactive, Active ↳ Mode	P.1
 <i>Permanent activation or deactivation of module/stage.</i>		


CLPU . 50/51 Stab.	[Protection Para / CLPU]	
Factor	inactive, Factor, Block. ↳ Operating Mode	P.1
 <i>Select whether the CLPU stabilization shall be effective for the Phase Overcurrent stages, and which operating mode shall be used.</i>		



CLPU . 50, 51 Factor	[Protection Para / CLPU]	
150% <i>Only available if:</i> <ul style="list-style-type: none"> CLPU . 50/51 Stab. = Factor 	100% ... 500%	P.1
 <i>If the operating mode has been set to increase the pickup threshold then this is the factor by which the pickup threshold of each the Phase Overcurrent stage is multiplied during the CLPU stabilization.</i>		

CLPU . 50 N/G, 51 N/G Stab.	[Protection Para / CLPU]	
inactive	inactive, Factor, Block. ↳ Operating Mode	P.1
 <i>Select whether the CLPU stabilization shall be effective for the Ground (Earth) Overcurrent stages, and which operating mode shall be used.</i>		


CLPU . 50 N/G, 51 N/G Factor		[Protection Para / CLPU]
150%	100% ... 500%	P.1
<i>Only available if:</i> <ul style="list-style-type: none"> CLPU . 50 N/G, 51 N/G Stab. = Factor 		
	<i>If the operating mode has been set to increase the pickup threshold then this is the factor by which the pickup threshold of each the Ground (Earth) Overcurrent stage is multiplied during the CLPU stabilization.</i>	

CLPU . tOff		[Protection Para / CLPU]
120.0min	0.1min ... 240.0min	P.1
	<i>Timer stage, that is started when the breaker position is detected as Off. (The next re-energization after this timer has expired will trigger the CLPU stabilization.)</i>	


CLPU . tStab		[Protection Para / CLPU]
5.0s	0.1s ... 1000.0s	P.1
	<i>Duration of the CLPU stabilization. This timer stage is started when the CLPU stabilization is triggered.</i>	


CLPU . ExBlo		[Protection Para / CLPU]
"-"	"-" ... Prot . Pos OFF	P.1
		
	<i>External blocking of the module if the state of the assigned signal is true.</i>	


9.21.3 CLPU: Input States

CLPU . ExBlo-I		[Operation / Status Display / CLPU]
	<i>Module input state: External blocking</i>	

9.21.4 CLPU: Signals (Output States)

CLPU . Active		[Operation / Status Display / All Actives]
	[Operation / Status Display / CLPU]	
	<i>Signal: active</i>	


CLPU . detected		[Operation / Status Display / CLPU]
	<i>Signal: The CLPU stabilization has been triggered.</i>	

CLPU . stab.		[Operation / Status Display / CLPU]
	<i>Signal: The CLPU stabilization is active.</i>	


9.22 Supervision


9.22.1 TCM - Trip Circuit Monitoring

9.22.1.1 TCM: Device Planning Parameters


TCM . Mode	[Device planning / Projected Elements]	
use	“-”, use ↳ Device planning	P.1
	<i>Trip Circuit Supervision, general operation mode</i>	

9.22.1.2 TCM: Settings


TCM . Function	[Protection Para / TCM]	
	Inactive, Active ↳ Mode	P.1
	<i>Permanent activation or deactivation of module/stage.</i>	

TCM . ExBlo	[Protection Para / TCM]	
“-”	“-” ... Prot . Pos OFF ↳	P.1
	<i>External blocking of the module if the state of the assigned signal is true.</i>	

9.22.1.3 TCM: Input States

TCM . ExBlo-I	[Operation / Status Display / TCM]	
	<i>Module input state: External blocking</i>	

9.22.1.4 TCM: Signals (Output States)

TCM . Active	[Operation / Status Display / All Actives]	
	[Operation / Status Display / TCM]	
	<i>Signal: active</i>	


9 Protection Parameter

9.22.1.4 TCM: Signals (Output States)


TCM . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / TCM]
↑↓	<i>Signal: Alarm</i>


9.22.2 BkrWear - Breaker Wear


9.22.2.1 BkrWear: Device Planning Parameters


BkrWear . Mode	[Device planning / Projected Elements]	
"-"	"-", Counters only, Counters, Wear Lev.	P.1
Only available if:	↳ Device planning	
• Prot . Settings valid = Software		
 Circuit Breaker Monitoring, general operation mode		

9.22.2.2 BkrWear: Settings

BkrWear . Function	[Protection Para / Condition Monitoring / BkrWear]	
Inactive	If: CT . CT Type = Relative • Inactive If: CT . CT Type ≠ Relative • Inactive, Active ↳ Mode	P.1
 Permanent activation or deactivation of the Breaker Wear function. <i>Important: The activation is only possible after the primary rated current »CT pri« has been set in the Field Parameters.</i>		


BkrWear . Alarm Thresh. Sum Trips	[Protection Para / Condition Monitoring / BkrWear]	
10000	1 ... 100000	P.1
 Maximum number of open commands, until the circuit breaker has to be maintained.		


BkrWear . Alarm Thresh. Sum Itrip	[Protection Para / Condition Monitoring / BkrWear]	
10.00kA	0.01kA ... 2000.00kA	P.1
 Maximum value for the sum of ruptured currents, until the circuit breaker has to be maintained.		


BkrWear . Max. CB Wear Level	[Protection Para / Condition Monitoring / BkrWear]	
100%	50% ... 100%	P.1
Only available if:		
• BkrWear . Mode = Counters, Wear Lev.		
 Maximum wear level (as a percentage), until the circuit breaker has to be maintained.		


9 Protection Parameter

9.22.2.3 BkrWear: Direct Controls


BkrWear . Ir	[Protection Para / Condition Monitoring / BkrWear]	
16.0A <i>Only available if:</i> • BkrWear . Mode = Counters, Wear Lev.	5.6A ... 10000.0A	P.1
 Rated current of the circuit breaker		

BkrWear . N(Ir)	[Protection Para / Condition Monitoring / BkrWear]	
100 <i>Only available if:</i> • BkrWear . Mode = Counters, Wear Lev.	2 ... 100000	P.1
 Number of switching operations at the rated current of the circuit breaker		


BkrWear . Isc	[Protection Para / Condition Monitoring / BkrWear]	
1120.0A <i>Only available if:</i> • BkrWear . Mode = Counters, Wear Lev.	16.0A ... 100000.0A	P.1
 Maximum short-circuit current of the circuit breaker		

BkrWear . N(Isc)	[Protection Para / Condition Monitoring / BkrWear]	
10 <i>Only available if:</i> • BkrWear . Mode = Counters, Wear Lev.	1 ... 50000	P.1
 Number of switching operations at the maximum short-circuit current of the circuit breaker		

9.22.2.3 BkrWear: Direct Controls

BkrWear . Reset	[Operation / Reset]	
False <i>Only available if:</i> • BkrWear . Mode = Counters, Wear Lev.	False, True True or not true	P.1
 Direct Command to reset the counters and the wear level of the circuit breaker.		

9.22.2.4 BkrWear: Signals (Output States)

BkrWear . Active	[Operation / Status Display / All Actives] [Operation / Status Display / BkrWear]	
 Signal: active		

BkrWear . Alarm	[Operation / Status Display / Alarms] [Operation / Status Display / BkrWear]
↑	<i>Signal: Alarm: The maximum number of open commands or the maximum value for the sum of ruptured currents has been exceeded.</i>

BkrWear . Alm(mx.Sum.Tr)	[Operation / Status Display / BkrWear]
↑	<i>Signal: Alarm: The maximum number of open commands has been exceeded.</i>

BkrWear . Alm(mx.Sum.Itrip)	[Operation / Status Display / BkrWear]
↑	<i>Signal: Alarm: The maximum value for the sum of ruptured currents has been exceeded.</i>

BkrWear . Alm (CB Wear Lev.)	[Operation / Status Display / BkrWear]
↑	<i>Signal: Alarm: The maximum wear level of the circuit breaker has been exceeded.</i>

9.22.2.5 BkrWear: Values

BkrWear . Sum Itrip	[Operation / Condition Monitoring / BkrWear]
✎	<i>Sum of the ruptured fault currents</i>

BkrWear . Bkr Wear Level	[Operation / Condition Monitoring / BkrWear]
✎	<p><i>Only available if:</i></p> <ul style="list-style-type: none"> • BkrWear . Mode = Counters, Wear Lev. <p><i>Wear level of the circuit breaker. (100% means that the circuit breaker has to be maintained.)</i></p>

9.22.2.6 BkrWear: Counters

BkrWear . Sum Trips	[Operation / Condition Monitoring / BkrWear]
#	<i>Sum of the previously executed open commands</i>

9.22.3 SBM - Station Battery Monitoring

9.22.3.1 SBM: Signals (Output States)

SBM . Active	[Operation / Status Display / All Actives]
⬆️	<i>Signal: active</i>


SBM . Trip	Not in menu tree, only: Event recorder
⬆️	<i>Signal: Trip</i>

SBM . Alarm	[Operation / Status Display / Alarms]
⬆️	<i>Signal: Alarm</i>

SBM . Pickup	[Operation / Status Display / Pickups]
⬆️	<i>Signal: Pickup</i>

10 Records

10.1 Fault recorder

Fault rec	[Operation / Recorders / Fault rec]
	<p>This item represents a special dialog. (See the Technical Manual for details.)</p> <p><i>The values measured at the time of tripping are saved by the Fault Recorder.</i></p>

11 Self-Supervision

11.1 Self-Supervision

Messages




[Operation / Self-Supervision / Messages]



This item represents a special dialog. (See the Technical Manual for details.)

Internal messages







12 Service

- Sys . User Restart:  [Table](#)
- Sys . Factory Reset:  [Table](#)
- Sys . Force Backup Prot.:  [Table](#)

13 Selection Lists

True or not true

Selection list referenced by the following parameters:







-  Sys . Rst. Err. LED
-  Sys . User Restart
-  Sys . Factory Reset
-  Sys . Force Backup Prot.
-  Prot . Rst. LEDs, Fls
-  Prot . Rst. Fault Records
- [...]

True or not true	Description
False	False
True	True

Mode

general operation mode

Selection list referenced by the following parameters:

-  Peak Current Ptr . Clear
-  Life Load . Function
-  Life Load . Rst. Alarm
-  Modbus . Rst. Counters
-  Prot . Out. Inverting
-  Prot . Force Trip Cmd
- [...]

Mode	Description
Inactive	Inactive
Active	Active

Device planning

Selection list referenced by the following parameters:

- [↪ DiggiMEC . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
DiggiMEC-A	<i>DiggiMEC variant A (1 flag indicator/output relay)</i>
DiggiMEC-B	<i>DiggiMEC variant B (3 flag indicators/output relays)</i>

Settings valid

Select which settings shall be valid: the settings made via Smart view/DiggiMEC or the switches on the housing. \n(If set to "Switches", then the respective default values are always used for all settings that are not associated with any switch.) \nNote that getting back from "Software" to "Switches" is not possible with this parameter, you have to execute a Reset to Factory Defaults instead!

Selection list referenced by the following parameters:

- [↪ Prot . Settings valid](#)

Settings valid	Description
Switches	<i>The settings made via the switches are used.</i>
Software	<i>The settings made via Smart view/DiggiMEC are used.</i>

Device planning

Selection list referenced by the following parameters:

- [↪ IH2 . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

- [↪ I> . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  I>> . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  I>>> . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  IG> . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  IG>> . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  I2/I1> . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  I2> . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  ThR . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

- [↳ Ipeak> . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

- [↳ SOTF . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

- [↳ Exp\[1\] . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

- [↳ Exp\[2\] . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  TCM . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  CBF . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

-  BkrWear . Mode

Device planning	Description
"_"	<i>Do not use</i>
Counters only	<i>The CBM function monitors the counters for the number of trip commands and for the sum of ruptured currents. An alarm will be issued if their respective limit is exceeded.</i>
Counters, Wear Lev.	<i>The CBM function monitors the counters and the wear level of the circuit breaker. An alarm will be issued if any of the maximum values is exceeded.</i>

Device planning

Selection list referenced by the following parameters:

-  CLPU . Mode

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Device planning

Selection list referenced by the following parameters:

- [↳ Life Load . Mode](#)

Device planning	Description
"_"	<i>Do not use</i>
use	<i>use</i>

Mode

general operation mode

Selection list referenced by the following parameters:

- [↳ Modbus . Mode](#)

Mode	Description
"_"	<i>Do not use</i>
RTU	<i>RTU</i>

Definition

If set to "Alarm": The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead. If set to "Trip": The function operates as a protection function, i.e. trips the breaker in case of a fault.

Selection list referenced by the following parameters:

- [↳ I> . Definition](#)
- [↳ I>> . Definition](#)
- [↳ I>>> . Definition](#)
- [↳ IG> . Definition](#)
- [↳ IG>> . Definition](#)

- [I2/I1> . Definition](#)
- [...]

Definition	Description
Trip	<i>The function operates as a protection function, i.e. trips the breaker in case of a fault.</i>
Alarm	<i>The function operates as a supervision function, i.e. a fault generates neither alarm nor trip, but an »Alarm« signal gets issued instead.</i>

Out. Mode

Select whether the output shall operate as an impulse output (for connecting a flag indicator with full compatibility to the 1st generation WIC1), or as a relay output (with a fixed, pre-defined usage as a self-supervision contact). \n(The usage as a self-supervision contact is only possible with an externally supplied WIC1-4, and connecting a flag indicator is not permissible with this setting.)

Selection list referenced by the following parameters:

- [Prot . Out. Mode](#)

Out. Mode	Description
Impulse Output	<i>The output shall operate as an impulse output (for connecting a flag indicator with full compatibility to the 1st generation WIC1).</i>
Syst. O.K. & Ext.Suppl.	<i>The output shall operate as as a self-supervision output, together with an external output relay. (See the User Manual chapter "Technical Data" for the specification of a compatible output relay).</i> <i>The signal at this output indicates that the WIC1 is running and is supplied by external auxiliary power and has loaded sufficient electrical energy for triggering the trip impulse output.</i>
Relay Output	<i>The output shall operate as as a relay output (for connecting an output relay).</i>

Selection list referenced by the following parameters:

- [DiggiMEC . FI / BO 1 assign.](#)
- [DiggiMEC . FI / BO 2 assign.](#)
- [DiggiMEC . FI / BO 3 assign.](#)
- [DiggiMEC . LED2 assign.](#)
- [DiggiMEC . LED3 assign.](#)
- [Prot . Out. assign.](#)
- [...]

	Description
"_"	
IH2 . Block. L1	Signal: Inrush blocking of phase L1 of the phase overcurrent protection
IH2 . Block. L2	Signal: Inrush blocking of phase L2 of the phase overcurrent protection
IH2 . Block. L3	Signal: Inrush blocking of phase L3 of the phase overcurrent protection
IH2 . Block. Ph.	Signal: Inrush blocking of a phase of the phase overcurrent protection
IH2 . Block. 3-ph	Signal: 3-phase Inrush blocking: An inrush has been detected in (at least) one phase, so that all three phases are blocked.
I> . Trip	Signal: Trip
I> . Alarm	Signal: Alarm
I> . Pickup	Signal: Pickup
I>> . Trip	Signal: Trip
I>> . Alarm	Signal: Alarm
I>> . Pickup	Signal: Pickup
I>>> . Trip	Signal: Trip
I>>> . Alarm	Signal: Alarm
I>>> . Pickup	Signal: Pickup
IG> . Trip	Signal: Trip
IG> . Alarm	Signal: Alarm
IG> . Pickup	Signal: Pickup
IG> . IH2 Blo	Signal: Blocking the trip command by an inrush
IG>> . Trip	Signal: Trip
IG>> . Alarm	Signal: Alarm
IG>> . Pickup	Signal: Pickup
IG>> . IH2 Blo	Signal: Blocking the trip command by an inrush
I2/I1> . Trip	Signal: Trip
I2/I1> . Alarm	Signal: Alarm
I2/I1> . Pickup	Signal: Pickup
I2/I1> . IH2 Blo	Signal: Blocking the trip command by an inrush
I2> . Trip	Signal: Trip
I2> . Alarm	Signal: Alarm
I2> . Pickup	Signal: Pickup
I2> . IH2 Blo	Signal: Blocking the trip command by an inrush
ThR . Trip	Signal: Trip
ThR . Alarm	Signal: Alarm
ThR . Pickup	Signal: Pickup
ThR . Pre-Alarm	Signal: The set value for the Θ Threshold has been exceeded.
Ipeak> . Trip	Signal: Trip
Ipeak> . Alarm	Signal: Alarm

	Description
Ipeak > . Pickup	<i>Signal: Pickup</i>
SOTF . Trip	<i>Signal: Trip</i>
SOTF . Alarm	<i>Signal: Alarm</i>
SOTF . Pickup	<i>Signal: Pickup</i>
Exp[1] . Trip	<i>Signal: Trip</i>
Exp[1] . Alarm	<i>Alarm</i>
Exp[1] . Pickup	<i>Signal: Pickup</i>
Exp[2] . Trip	<i>Signal: Trip</i>
Exp[2] . Alarm	<i>Alarm</i>
Exp[2] . Pickup	<i>Signal: Pickup</i>
TCM . Alarm	<i>Signal: Alarm</i>
CBF . Alarm	<i>Signal: Alarm</i>
BkrWear . Alarm	<i>Signal: Alarm: The maximum number of open commands or the maximum value for the sum of ruptured currents has been exceeded.</i>
BkrWear . Alm(mx.Sum.Tr)	<i>Signal: Alarm: The maximum number of open commands has been exceeded.</i>
BkrWear . Alm(mx.Sum.Itrip)	<i>Signal: Alarm: The maximum value for the sum of ruptured currents has been exceeded.</i>
BkrWear . Alm (CB Wear Lev.)	<i>Signal: Alarm: The maximum wear level of the circuit breaker has been exceeded.</i>
CLPU . detected	<i>Signal: The CLPU stabilization has been triggered.</i>
CLPU . stab.	<i>Signal: The CLPU stabilization is active.</i>
Life Load . Alarm	<i>Signal: Alarm</i>
Sys . New error/warning	<i>Signal: A new Self-Supervision message (error or warning) has been issued.</i>
Sys . Prot. Ready	<i>Signal: The device has completely booted, all protection functions are running and there is enough electrical energy for a trip pulse.</i>
Sys . Intern.Volt. not OK	<i>Signal: The self-supervision of the device has determined a problem with the internal voltage level or energy supply. This might impair the overall protection functionality, including the possibility to output a trip pulse. (If the supply via the connected CTs is sufficient you might want to check for a potential energy drain through the devices connected to the output(s).)</i>
Prot . TripCmd	<i>Signal: Trip Command</i>
Prot . Trip	<i>Signal: General Trip</i>
Prot . Alarm	<i>Signal: General Alarm</i>
Prot . Pickup	<i>Signal: General Pickup</i>
Prot . Trip IPh	<i>Signal: General Trip due to a phase current fault</i>
Prot . Trip IG	<i>Signal: General Trip due to a ground current fault</i>
Prot . Trip Ext.	<i>Signal: General Trip due to an external signal</i>
Prot . Trip IL1	<i>Signal: General Trip due to a fault in phase L1</i>
Prot . Trip IL2	<i>Signal: General Trip due to a fault in phase L2</i>
Prot . Trip IL3	<i>Signal: General Trip due to a fault in phase L3</i>
Prot . Pickup I Ph	<i>Signal: General Pickup due to a phase current fault</i>
Prot . Pickup IG	<i>Signal: General Pickup due to a ground current fault</i>

	Description
Prot . Pickup Ext.	Signal: General Pickup due to an external signal
Prot . DI 1	Signal: Digital Input
Prot . DI 2	Signal: Digital Input
Prot . Pos ON	Signal: Circuit Breaker is in ON-Position
Prot . Pos OFF	Signal: Circuit Breaker is in OFF-Position

Nom voltage

Nominal voltage of the digital inputs

Selection list referenced by the following parameters:

-  Prot . Nom voltage

Nom voltage	Description
24 VDC	24 VDC
48 VDC ... 60 VDC	48 VDC ... 60 VDC
110 VDC	110 VDC
230 VDC	230 VDC
110 VAC	110 VAC
230 VAC	230 VAC
115 VAC / 230 VAC	115 VAC / 230 VAC (depending on the input)

My Language

Selection list referenced by the following parameters:

-  DiggiMEC . Menu language

My Language	Description
English	English

Operation Preference

If set to “Early wake-up”, the DiggiMEC is fully available at smaller primary currents, but at the cost of more inaccurate WIC1 measurement values. If set to “Precise meas.”, the DiggiMEC gets fully available only with higher primary currents, but the WIC1

measurement values will be more precise. In general, it is recommended to keep the default “Precise meas.”.

Selection list referenced by the following parameters:

- [↳ DiggiMEC . Operation Preference](#)

Operation Preference	Description
Precise meas.	<i>With this setting, the DiggiMEC gets fully available only with higher primary currents, but the WIC1 measurement values will be more precise.</i>
Early wake-up	<i>With this setting, the DiggiMEC is fully available at smaller primary currents, but at the cost of more inaccurate WIC1 measurement values. If set to “Precise meas.”, the DiggiMEC gets fully available only with higher primary currents, but the WIC</i>

Latching

Activates/deactivates latching and the type of automatical reset of the latching.

Selection list referenced by the following parameters:

- [↳ DiggiMEC . FI / BO 1 latching](#)
- [↳ DiggiMEC . FI / BO 2 latching](#)
- [↳ DiggiMEC . FI / BO 3 latching](#)
- [↳ DiggiMEC . LED2 latching](#)
- [↳ DiggiMEC . LED3 latching](#)

Latching	Description
No latching	<i>No latching, the status always follows the status of the assigned signal.</i>
With latching	<i>With latching, i.e. the state remains active once the the assigned signal has become active. (After the assigned signal has dropped off the state can be reset by the device.)</i>
Latch. w. Auto-Reset	<i>With latching, i.e. the state remains active once the the assigned signal has become active. In addition to a reset via DiggiMEC-HMI or via Digital Input there is also the automatical reset permitted.</i>

Color

Select the “active” color (if the assigned signal is active) and the “inactive” color (if the assigned signal is inactive)




Selection list referenced by the following parameters:

- [↳ DiggiMEC . LED2 Color](#)

Color	Description
Red	<i>Red = “active” color (if the assigned signal is active)</i>

Color	Description
Green	Green = "active" color (if the assigned signal is active)
Green / Red	Green = "active" color (if the assigned signal is active), red = "inactive" color (if the assigned signal is inactive)

Selection list referenced by the following parameters:

-  Prot . Assign Ext. Reset
-  Prot . Aux ON
-  Prot . Aux OFF
-  Prot . SCmd ON
-  ExP[1] . Trigger Signal
-  ExP[2] . Trigger Signal

	Description
"_"	
Prot . DI 1	Signal: Digital Input
Prot . DI 2	Signal: Digital Input

Def. Autom. Reset

The automatic reset will reset all latched LEDs, all DiggiMEC Flag Indicators, and a fault/trip info that might be visible on the DiggiMEC display. This is done depending on this setting, when a new protection pickup occurs or after a particular time has elapsed.

Selection list referenced by the following parameters:

-  Prot . Def. Autom. Reset

Def. Autom. Reset	Description
OFF (=No Autom. Reset)	OFF (=No Autom. Reset)
With a New Pickup	Automatic Reset when a new protection trip occurs
New Pickup or After 1 h	Automatic Reset when a new protection trip occurs or after 1 hour
New Pickup or After 2 h	Automatic Reset when a new protection trip occurs or after 2 hours
New Pickup or After 4 h	Automatic Reset when a new protection trip occurs or after 4 hours
New Pickup or After 8 h	Automatic Reset when a new protection trip occurs or after 8 hours
New Pickup or After 12 h	Automatic Reset when a new protection trip occurs or after 12 hours
New Pickup or After 24 h	Automatic Reset when a new protection trip occurs or after 24 hours

Def. Autom. Reset	Description
New Pickup or After 10 s	<i>Automatic Reset when a new protection trip occurs or after 10 seconds</i>

Reset via »C« key

Select whether a reset via »C« key shall be password-protected.

Selection list referenced by the following parameters:

-  [DiggiMEC . Reset via »C« key](#)

Reset via »C« key	Description
Without Password	<i>A reset via »C« key can be done without password query.</i>
With Password	<i>A reset via »C« key requires entering the password.</i>

Allow invalid addr.

Select the rule how the device shall handle the query for an invalid start address (or an address range with internal “gaps”).

Selection list referenced by the following parameters:

-  [Modbus . Allow invalid addr.](#)

Allow invalid addr.	Description
Send an exception	<i>The device answers with an exception whenever the requested address range contains an invalid address.</i>
Inv. addr. are allowed	<i>The device accepts invalid addresses within the requested address range without sending an exception.</i>

Baud rate

Selection list referenced by the following parameters:

-  [Modbus . Baud rate](#)

Baud rate	Description
1200	<i>1200</i>
2400	<i>2400</i>
4800	<i>4800</i>
9600	<i>9600</i>

Baud rate	Description
19200	19200
38400	38400

Physical Settings

Digit 1: Number of bits. Digit 2: E=even parity, O=odd parity, N=no parity. Digit 3: Number of stop bits. More information on the parity: It is possible that the last data bit is followed by a parity bit which is used for recognition of communication errors. The parity bit ensures that with even parity ("EVEN") always an even number of bits with valence "1" or with odd parity ("ODD") an odd number of "1" valence bits are transmitted. But it is also possible to transmit no parity bits (here the setting is "Parity = None"). More information on the stop-bits: The end of a data byte is terminated by the stop-bits.

Selection list referenced by the following parameters:

- [↳ Modbus . Physical Settings](#)

Physical Settings	Description
8E1	8 data bits, even parity, 1 stopbit.
8O1	8 data bits, odd, 1 stopbit.
8N1	8 data bits, no parity, 1 stopbit.
8N2	8 data bits, no parity, 2 stopbits.

Phase Sequence

Selection list referenced by the following parameters:

- [↳ CT . Phase Sequence](#)

Phase Sequence	Description
ABC	Clockwise Rotating Field ("ABC" = "L1-L2-L3")
ACB	Anti-Clockwise Rotating Field ("ACB" = "L1-L3-L2")

fN

Selection list referenced by the following parameters:

- [↳ CT . f](#)

fN	Description
50	<i>Rated frequency</i>
60	<i>Rated frequency</i>

Measuring method

Measuring method: fundamental or rms or 3rd harmonic (only generator protection relays)

Selection list referenced by the following parameters:

- [↳ CT . Measuring method](#)

Measuring method	Description
Fundamental	<i>Protection is based on Fundamental (1st. Harmonic)</i>
True RMS	<i>Protection is based on root-mean-square value (True RMS)</i>

IG Source

Selection if measured or calculated ground current should be used.

Selection list referenced by the following parameters:

- [↳ CT . IG Source](#)

IG Source	Description
calculated	<i>calculated</i>
measured	<i>measured</i>

Display of Meas. Values

Select the preferred scaling/unit for the display of measurement values.

Selection list referenced by the following parameters:



- [↳ CT . Display of Meas. Values](#)

Display of Meas. Values	Description
Based on In,relative	<i>All current measuring values are displayed based on In,relative.</i>
Primary current values	<i>All current measuring values are displayed as primary currents.</i>

CT Type

Select the connected CT Type (for the display of primary or relative phase current values).



Selection list referenced by the following parameters:

-  CT . CT Type
-  CT . CT Type

CT Type	Description
Relative	<i>Phase current values are displayed as relative values.</i>
WE2 : 16 A ... 56 A	<i>Phase current values are displayed as primary values, that are calculated based on the connected CT type with primary current range 16 A ... 56 A.</i>
W2 : 16 A ... 56 A	<i>Phase current values are displayed as primary values, that are calculated based on the connected CT type with primary current range 16 A ... 56 A.</i>
W3 : 32 A ... 112 A	<i>Phase current values are displayed as primary values, that are calculated based on the connected CT type with primary current range 32 A ... 112 A.</i>
W4 : 64 A ... 224 A	<i>Phase current values are displayed as primary values, that are calculated based on the connected CT type with primary current range 64 A ... 224 A.</i>
W5 : 128 A ... 448 A	<i>Phase current values are displayed as primary values, that are calculated based on the connected CT type with primary current range 128 A ... 448 A.</i>
W6 : 256 A ... 896 A	<i>Phase current values are displayed as primary values, that are calculated based on the connected CT type with primary current range 256 A ... 896 A.</i>
Standard	<i>Standard</i>

Polarity

Selection list referenced by the following parameters:

-  CT . CT Shift by 0°/180°
-  CT . ECT Shift by 0°/180°

Polarity	Description
0	<i>0</i>
180	<i>180 degree polarity correction (wiring faults)</i>

Meth.Detect.Bkr.Pos.

Select the method to be used to determine the connected breaker position.

Selection list referenced by the following parameters:

-  Prot . Meth.Detect.Bkr.Pos.

Meth.Detect.Bkr.Pos.	Description
Current-Based	The breaker position is determined based on current measurement.
Aux-Based	The breaker position is dependent on a particular input signal (Aux contacts 52a/52b of the circuit breaker).
Current and Aux	The breaker position is determined based on current measurement AND input signal (Aux contacts 52a/52b of the circuit breaker).

Char

Characteristic

Selection list referenced by the following parameters:

- [↳ I> . Char](#)

Char	Description
DEFT	DEFT
IEC NINV	IEC Normal Inverse
IEC VINV	IEC Very Inverse [VINV]
IEC EINV	IEC Extremely Inverse - Characteristic
IEC LINV	IEC Long Time Inverse - Characteristic [LINV]
RINV	R Inverse [RINV] - Characteristic
HV Fuse	Overcurrent characteristic "HV Fuse"
FR Fuse	Overcurrent characteristic "FR Fuse"
IEEE MINV	IEEE Moderately Inverse [MINV] - Characteristic
IEEE VINV	IEEE Very Inverse [VINV]
IEEE EINV	IEEE Extremely Inverse - Characteristic
EF Curve	Overcurrent characteristic "EF Response Curve"

Reset Mode

Selection list referenced by the following parameters:

- [↳ I> . Reset Mode](#)

Reset Mode	Description
instantaneous	Instantaneous reset: when the current drops below the pickup setting, the TOC time resets to zero within 2 cycles.
definite time	Reset after a fixed time. (Remark: This delay is then defined by the parameter »t-reset delay«.)

Reset Mode	Description
inverse time	Calculated reset, based on the selected characteristic.

Char

Characteristic

Selection list referenced by the following parameters:

-  I>> . Char

Char	Description
DEFT	DEFT
IEC NINV	IEC Normal Inverse
IEC VINV	IEC Very Inverse [VINV]
IEC EINV	IEC Extremely Inverse - Characteristic
IEC LINV	IEC Long Time Inverse - Characteristic [LINV]
RINV	R Inverse [RINV] - Characteristic
HV Fuse	Overcurrent characteristic "HV Fuse"
FR Fuse	Overcurrent characteristic "FR Fuse"
IEEE MINV	IEEE Moderately Inverse [MINV] - Characteristic
IEEE VINV	IEEE Very Inverse [VINV]
IEEE EINV	IEEE Extremely Inverse - Characteristic
EF Curve	Overcurrent characteristic "EF Response Curve"

Reset Mode

Selection list referenced by the following parameters:

-  I>> . Reset Mode

Reset Mode	Description
instantaneous	Instantaneous reset: when the current drops below the pickup setting, the TOC time resets to zero within 2 cycles.
definite time	Reset after a fixed time. (Remark: This delay is then defined by the parameter »t-reset delay«.)
inverse time	Calculated reset, based on the selected characteristic.

Char

Characteristic

Selection list referenced by the following parameters:

-  I>>> . Char

Char	Description
DEFT	DEFT
IEC NINV	IEC Normal Inverse
IEC VINV	IEC Very Inverse [VINV]
IEC EINV	IEC Extremely Inverse - Characteristic
IEC LINV	IEC Long Time Inverse - Characteristic [LINV]
RINV	R Inverse [RINV] - Characteristic
HV Fuse	Overcurrent characteristic "HV Fuse"
FR Fuse	Overcurrent characteristic "FR Fuse"
IEEE MINV	IEEE Moderately Inverse [MINV] - Characteristic
IEEE VINV	IEEE Very Inverse [VINV]
IEEE EINV	IEEE Extremely Inverse - Characteristic
EF Curve	Overcurrent characteristic "EF Response Curve"

Reset Mode

Selection list referenced by the following parameters:

-  I>>> . Reset Mode

Reset Mode	Description
instantaneous	Instantaneous reset: when the current drops below the pickup setting, the TOC time resets to zero within 2 cycles.
definite time	Reset after a fixed time. (Remark: This delay is then defined by the parameter »t-reset delay«.)
inverse time	Calculated reset, based on the selected characteristic.

Char

Characteristic

Selection list referenced by the following parameters:

-  IG> . Char

Char	Description
DEFT	DEFT
IEC NINV	IEC Normal Inverse
IEC VINV	IEC Very Inverse [VINV]
IEC EINV	IEC Extremely Inverse - Characteristic
IEC LINV	IEC Long Time Inverse - Characteristic [LINV]
RINV	R Inverse [RINV] - Characteristic
HV Fuse	Overcurrent characteristic "HV Fuse"
FR Fuse	Overcurrent characteristic "FR Fuse"
IEEE MINV	IEEE Moderately Inverse [MINV] - Characteristic
IEEE VINV	IEEE Very Inverse [VINV]
IEEE EINV	IEEE Extremely Inverse - Characteristic
EF Curve	Overcurrent characteristic "EF Response Curve"
RXIDG	Overcurrent characteristic "RXIDG"

Reset Mode

Selection list referenced by the following parameters:

-  IG> . Reset Mode

Reset Mode	Description
instantaneous	Instantaneous reset: when the current drops below the pickup setting, the TOC time resets to zero within 2 cycles.
definite time	Reset after a fixed time. (Remark: This delay is then defined by the parameter »t-reset delay«.)
inverse time	Calculated reset, based on the selected characteristic.

Char

Characteristic

Selection list referenced by the following parameters:

-  IG>> . Char

Char	Description
DEFT	DEFT
IEC NINV	IEC Normal Inverse

Char	Description
IEC VINV	IEC Very Inverse [VINV]
IEC EINV	IEC Extremely Inverse - Characteristic
IEC LINV	IEC Long Time Inverse - Characteristic [LINV]
RINV	R Inverse [RINV] - Characteristic
HV Fuse	Overcurrent characteristic "HV Fuse"
FR Fuse	Overcurrent characteristic "FR Fuse"
IEEE MINV	IEEE Moderately Inverse [MINV] - Characteristic
IEEE VINV	IEEE Very Inverse [VINV]
IEEE EINV	IEEE Extremely Inverse - Characteristic
EF Curve	Overcurrent characteristic "EF Response Curve"
RXIDG	Overcurrent characteristic "RXIDG"

Reset Mode

Selection list referenced by the following parameters:

- [IG>>](#) . Reset Mode

Reset Mode	Description
instantaneous	Instantaneous reset: when the current drops below the pickup setting, the TOC time resets to zero within 2 cycles.
definite time	Reset after a fixed time. (Remark: This delay is then defined by the parameter »t-reset delay«.)
inverse time	Calculated reset, based on the selected characteristic.

Char

Characteristic

Selection list referenced by the following parameters:

- [I2>](#) . Char

Char	Description
DEFT	DEFT
IEC NINV	IEC Normal Inverse
IEC VINV	IEC Very Inverse [VINV]
IEC EINV	IEC Extremely Inverse - Characteristic

Char	Description
IEC LINV	<i>IEC Long Time Inverse - Characteristic [LINV]</i>
RINV	<i>R Inverse [RINV] - Characteristic</i>
HV Fuse	<i>Overcurrent characteristic "HV Fuse"</i>
FR Fuse	<i>Overcurrent characteristic "FR Fuse"</i>
IEEE MINV	<i>IEEE Moderately Inverse [MINV] - Characteristic</i>
IEEE VINV	<i>IEEE Very Inverse [VINV]</i>
IEEE EINV	<i>IEEE Extremely Inverse - Characteristic</i>
EF Curve	<i>Overcurrent characteristic "EF Response Curve"</i>

Reset Mode

Selection list referenced by the following parameters:

-  I2> . Reset Mode

Reset Mode	Description
instantaneous	<i>Instantaneous reset: when the current drops below the pickup setting, the TOC time resets to zero within 2 cycles.</i>
definite time	<i>Reset after a fixed time. (Remark: This delay is then defined by the parameter »t-reset delay«.)</i>
inverse time	<i>Calculated reset, based on the selected characteristic.</i>

Initial Thermal Level

Select the criterion for setting the initial thermal level after a restart of the device.

Selection list referenced by the following parameters:

-  ThR . Initial Thermal Level

Initial Thermal Level	Description
Zero	<i>After a restart of the device, always set the initial value to 0.</i>
Last Stored Value	<i>After a restart of the device, restore the initial value to the last known value, that had been valid before the restart of the device.</i>

Enabling

Select the criterion for determining a manual CLOSE of the breaker. (After this, the »SOTF« module gets enabled for a particular settable time.)

Selection list referenced by the following parameters:

- [SOTF . Enabling](#)

Enabling	Description
Breaker Pos.	<i>A (manual) CLOSE command is determined based on the breaker position. (Note that the determination of breaker positions needs to be configured separately.)</i>
Close Command	<i>A CLOSE command being executed enables the »SOTF« module.</i>

Selection list referenced by the following parameters:

- [SOTF . Trigger](#)
- [Exp\[2\] . Condition](#)

	Description
“_”	
I> . Pickup	<i>Signal: Pickup</i>
I>> . Pickup	<i>Signal: Pickup</i>
I>>> . Pickup	<i>Signal: Pickup</i>
Ipeak> . Pickup	<i>Signal: Pickup</i>
Prot . Pickup	<i>Signal: General Pickup</i>

Operating Mode

Operating Mode of the Cold Load Pickup stabilization

Selection list referenced by the following parameters:

- [CLPU . 50/51 Stab.](#)
- [CLPU . 50 N/G, 51 N/G Stab.](#)

Operating Mode	Description
inactive	<i>The Cold Load Pickup stabilization is inactive.</i>
Factor	<i>The Cold Load Pickup stabilization (temporarily) increases the pickup threshold of the (phase and/or ground) overcurrent protection.</i>
Block.	<i>The Cold Load Pickup stabilization (temporarily) blocks the (phase and/or ground) overcurrent protection.</i>

Time win. for calc. avg.

Select the time-window for calculating average values

Selection list referenced by the following parameters:

-  Peak Current Ptr . Time win. for calc. avg.

Time win. for calc. avg.	Description
1 min	1 min
8 min	8 min
15 min	15 min
20 min	20 min

I

The sum of operating times in current ranges above this value is monitored.

Selection list referenced by the following parameters:

-  Life Load . I

I	Description
> 0.4 In	> 0.4 In
> 0.5 In	> 0.5 In
> 0.6 In	> 0.6 In
> 0.7 In	> 0.7 In
> 0.8 In	> 0.8 In
> 0.9 In	> 0.9 In
> 1.0 In	> 1.0 In
> 1.1 In	> 1.1 In
> 1.2 In	> 1.2 In

Index

.....	129, 134, 145
A	
Allow invalid addr.	135
B	
Baud rate	135
BkrWear	115, 115, 116, 116, 117, 117
C	
CBF	109, 109, 109, 109
CLPU	111, 111, 112, 112
CT	17, 20, 23
CT Type	138
Char	139, 140, 141, 141, 142, 143
Color	133
D	
Def. Autom. Reset	134
Definition	128
Device planning	123, 123, 123, 124, 124, 124, 124, . 125, 125, 125, 126, 126, 126, 126, 127, 127, 127, 127, 128
DiggiMEC	13, 13
Display of Meas. Values	137
E	
Enabling	145
Exp[1]	102, 102, 104, 104
Exp[2]	105, 105, 107, 107

F

fN 136

I

I 146

I2/I1> 85, 85, 86, 86

I2> 88, 88, 91, 91

I> 50, 50, 54, 54

I>> 57, 57, 61, 61

I>>> 64, 64, 68, 68

IG Source 137

IG> 71, 71, 76, 76

IG>> 78, 78, 83, 83

IH2 48, 48, 49

Initial Thermal Level 144

Ipeak> 96, 96, 97, 97

L

Latching 133

Life Load 32, 32, 32, 33, 33, 33

M

Measuring method 137

Meth.Detect.Bkr.Pos. 138

Modbus 34, 34, 35, 35

Mode 122, 128

My Language 132

N

Nom voltage 132

O

Operating Mode 145

Operation Preference	133
Out. Mode	129

P

Peak Current Ptr	31, 31, 31
Phase Sequence	136
Physical Settings	136
Polarity	138
Prot	36, 36, 43, 44, 44, 47

R

Reset Mode	139, 140, 141, 142, 143, 144
Reset via »C« key	135

S

SBM	118
SOTF	99, 99, 100, 100
Settings valid	123
Sys	27, 27

T


TCM	113, 113, 113, 113
ThR	93, 93, 94, 94, 94, 95
Time win. for calc. avg.	146
True or not true	122

WI Line

WIC1

REFERENCE MANUAL

docs.SEGelectronics.de/wic1



SEG Electronics GmbH reserves the right to update any portion of this publication at any time. Information provided by SEG Electronics GmbH is believed to be correct and reliable. However, SEG Electronics GmbH assumes no responsibility unless otherwise expressly undertaken.



SEG Electronics GmbH

Krefelder Weg 47 • D-47906 Kempen (Germany)

Telephone: +49 (0) 21 52 145 1

Internet: www.SEGelectronics.de

Sales

Telephone: +49 (0) 21 52 145 331

Fax: +49 (0) 21 52 145 354

E-mail: sales@SEGelectronics.de

Service

Telephone: +49 (0) 21 52 145 600

Fax: +49 (0) 21 52 145 354

E-mail: support@SEGelectronics.de

Complete address / phone / fax / email information for all locations is available on our website.